

BRIMSTONE STS, LTD.

SULFUR PRODUCTION - NOTE SET

<u>SECTION CONTENTS</u>	<u>PAGES</u>
1. Outline, Contents	1
2. Sulfur Overview: Notes Pages	2-9
3. Sulfur Production - Note Set	
Introduction	12-14
Flowsheet Variations	14-17
EUROCLAUS®	18
Temperature Effects	19
COS, CS ₂ Hydrolysis	19
Sweetening/Sulfur Recovery/Tail Gas	20
Example Recovery Needed	21
Sulfur Species	21
Air Requirements Incl. Hydrocarbons	22
Catalysts	23
Ratio Control	24-25
Sulfur Product Specifications; Viscosity	26
Sulfur Viscosity	27
Superclaus®	28
Oxygen Enrichment	29
Selectox®	29
SCOT® Tail Gas	30
4. Process Flag Sheet and Example Computer Output	32-47



© D.J. Morgan 2012

BRIMSTONE STS, LTD.
SULFUR RECOVERY SYMPOSIUM
CLAUS PROCESS NOTES


File: Brimstone\Vail\2009\ClausProcessNotes.doc

The following lined-pages highlight
some important Claus Process topics.

1. CHEMISTRY



Adding these equations gives:



2. CLAUS CONFIGURATIONS

2.1 Furnace Arrangements

Straight-through _____

Split-flow _____

Preheat, Sulfur-recycle etc. _____

Superclaus _____

2.2 Non-furnace arrangements

Selectox _____

Clinsulf _____

2.3 Recovery Levels, 2 - 3 converter _____

Refinery and Gas Processing applications contrasted _____

Oxygen enrichment: Temperature, pressure drop, WHB/condenser duties, affect on Tail Gas
Clean-up Unit (TGCU) _____

3. ENVIRONMENTAL REGULATIONS

Sulfur Recovery Emission Standards:

US (national and regional), NSPS, NESHAPS, BACT, MACT

Canadian and International

SO_x CO NMHC H₂S S NO_x RSH COS CS₂ Other sulfur compounds

4. CLAUS DESIGN & COMPUTER SIMULATION

Typical Flowsheet _____

Acid Gas H₂S/CO₂ ratio _____

Tonnage _____

Reheat schemes _____

Turndown Required _____

Steam generation levels: HP LP VLP BFW-preheat. Other heat removal methods - Hot Oil etc

Tail Gas Composition _____

Simulation Output _____

5. OPERATING RELIABILITY & EFFICIENCY

Operating conditions - particularly temperatures _____

Feed impurities: hydrocarbons, NH₃, HCN, excessive water, trace sulfur (RSH etc), others

Feed Gas analysis: acid gas, sour water stripper (SWS) gas _____

Failure to meet required performance; plant testing _____

Turndown _____

Supplemental fuel-gas firing; fuel gas quality _____

Start-up/Shutdown Procedures (include. TGCU), hot-relight _____

Leak detection: WHB/condenser. Pits - cover, steam coils, eductor _____

Plugging/Fouling: Sulfur drains/seals, catalyst beds, piping, exchanger tubes, mesh pads, overall unit pressure drop _____

6. REACTION FURNACE

Burner type & configuration _____

Residence time _____

Refractory _____

Checker walls _____

Flame detection _____

Sight ports _____

Air purges _____

COS, CS₂ formation, actual/predicted _____

NH₃ destruction, temperature, burner type _____

Affects of hydrocarbons in feed _____

Temperature measurement: thermocouple type, optical (IR), calibration _____

7. OVERALL CLAUS PROCESS EQUIPMENT

Blower _____

Furnace _____

Burner _____

Waste Heat Boiler _____

Reheat Methods _____

Converters _____

Condensers _____

Coalescers _____

Incinerator/Thermal Oxidizer _____

Catalytic Incineration _____

8. CATALYST ISSUES

Types _____

Sulfation _____

Carbon Deposition _____

Heat soak _____

Start-up & shut-down _____

Improving catalyst life and efficiency. Causes of Deactivation. _____

Bed Fires on Shutdown _____

9. INSTRUMENTATION

Feed-forward _____

Tail gas ratio-control (feed-back), dead-time. Trim air valve or adjust air/acid gas ratio _____

Reaction Furnace _____

10. SULFUR SPECIFICATIONS & PROPERTIES

Density, viscosity, various sulfur forms S₂ S₆ etc. _____

11. PRODUCED SULFUR HANDLING

Sulfur Seals _____

Sulfur Pits _____

Sulfur Pumps _____

Sulfur Tanks _____

Sulfur Degassing _____

Sulfur Forming/Shipping _____

12. OTHER ISSUES

BRIMSTONE STS, LTD.

SULFUR SYMPOSIUM

SULFUR PRODUCTION
NOTE SET


©D. J. Morgan 2009

SULFUR PRODUCTION


A. Claus Process

The Claus process is the best known and most widely-used sulfur production process in industry. It is a modification of a process first used in 1883. It is most applicable for production of sulfur from acid gas streams containing from about 20 to 100% H₂S.

The first step of the Claus process is the complete free-flame oxidation of 1/3 of the H₂S to SO₂ in a reaction furnace:



The SO₂ and the remaining H₂S then undergo the Claus reaction in the reaction furnace and a series of catalytic reactors:



There are several variations of the Claus process with the two most common being the straight-through design, and the split flow design. The choice of the most suitable configuration depends on the composition of the feed gas, with the H₂S content of the acid gas being the most important variable. General guidelines are shown.

In the straight-through variation, the acid gas stream passes through the reaction furnace with sufficient air to convert 1/3 of the H₂S fed to the furnace to SO₂. The primary requirement in the reaction furnace is to maintain a stable flame at a sufficiently high temperature to advance the reaction between H₂S and O₂. Gases leaving the furnace flow through the first pass of a waste heat boiler. In hot gas bypass reheat schemes part of the gas enters the second pass of the boiler for further cooling. The hot gas which bypassed the second pass of the boiler is mixed with the reactor feed streams for reheat. The hot gas bypass reheat scheme is the most economical. However, it has important turndown limitations.

Sulfur produced in each stage is condensed and removed from the process. Tail gas from the last condenser pass is treated in a tail gas treating unit to remove residual sulfur compounds.

Among the advantages of the Claus process are:

- Well proven technology.
- Can produce bright sulfur.
- Can be designed to convert COS and destroy NH₃ and HCN.
- Relatively low operating costs due to credit for net steam production.

The disadvantages of the Claus process include:

- Requires an acid gas feed stream relatively rich in H₂S (usually more than 15%) although significantly leaner feed can be handled.
- Maximum recovery is about 97% on Claus which often therefore requires a subsequent tail gas cleanup unit.

Heavier Hydrocarbons in the Feed

A better understanding of reaction furnace burner design and reaction furnace chemistry has allowed the successful treatment of acid gases containing progressively higher amounts of heavy hydrocarbons and other contaminants such as ammonia¹². So called "high intensity burners" permit the successful destruction of up to at least C₄ components in a straight-through reaction furnace.

Oxygen Enrichment

Oxygen enrichment of the acid gas feed (CO_2 plus H_2S) to the Claus Sulfur Process has occasionally been practiced in Europe. There is renewed interest in this process variation in North America, primarily for capacity increase in existing sulfur plants⁶. The COPE Process has been successfully commercialized and is shown in Figure 9-19a.



B. SELECTOX

The traditional Claus sulfur plant has a fired reaction furnace as the first item of equipment. However, for very dilute acid gas streams (less than 10% H_2S , the balance CO_2) this reaction furnace does not operate stably even with acid gas and air preheat. There have been problems with earlier all-catalytic processes to react H_2S with air to form sulfur. However, in the last few years, the Selectox process has been successfully operated as an all-catalytic process to convert the H_2S in relatively dilute acid gas streams into sulfur⁷.


The Selectox process was developed by Union Oil Company of California, Ralph M. Parsons Company and Perry/Goar Sulfur Systems. It is intended for those acid gas streams that are too lean in H_2S to feed to a conventional Claus unit.

The Selectox catalyst selectively oxidizes H_2S to sulfur with air at low temperature without forming SO_3 or oxidizing significant amounts of hydrogen or light hydrocarbons. This process is entirely catalytic, there is no high-temperature combustion as in the Claus Process.

When supplied with the proper amount of air, the oxidation of one-third of the H_2S to SO_2 and the reaction of SO_2 with the remaining two-thirds of H_2S occur simultaneously in the presence of the Selectox catalyst to form elemental sulfur:



The effective overall reaction (the same as for Claus) is therefore:



One variation of the Selectox process is used when the acid gas feed is below approximately 5% volume H_2S . The exothermic reaction with 5% H_2S gas results in a reasonable maximum reactor outlet temperature at about 700°F. After the Selectox reactor, the gas is cooled and sulfur is condensed.

When the gas feed contains more than 5% volume H_2S , some of the cooled lean gas from the sulfur condenser is reheated and recycled to the Selectox reactor inlet to maintain approximately 5% H_2S at the reactor inlet. This variation of the process is called Recycle Selectox (Figure 9-19b).

In either process, gas from the sulfur condenser may then pass through one or two Claus stages, each with a re-heater, converter, and sulfur condenser. The system for the Selectox and the Claus reactors is the same: heating gas to the desired inlet temperature, reaction in a converter, and cooling the gas and condensing sulfur in a condenser.

Sulfur recoveries are in the range of 90%. The first industrial plant using Selectox catalyst has been operating since 1978 and the first Recycle Selectox unit has been operating since December, 1981.



The Selectox process has the following advantages:

- Can process acid gas streams that are lean in H_2S ($\leq 5\%$).
- Produces high quality bright sulfur.

The primary disadvantages of the Selectox process are:

- Inability to convert COS, present in the feed, to sulfur.
- Inability to destroy NH₃ and HCN upstream of the catalytic reactors.
- Tail gas treating is needed to achieve 99+% sulfur recovery.

Overall Claus Reaction



Adding Reactions 1 and 2 and Cancelling Gives:




FIGURE 9-1

Feed H ₂ S Concentration, Mol %	Claus Variation Suggested
55 – 100	Straight-through
30 – 55	Straight-through or straight-through with acid gas and/or air preheat
15– 30	Split-flow or straight-through with feed and/or air preheat
10 – 15	Split-flow with acid gas and/or air preheat
5 – 10	Split-flow with fuel added or with acid gas and air preheat, or direct oxidation or sulfur recycle
< 5	Sulfur recycle or variations of direct oxidation or other sulfur recovery processes


Claus Plant Configurations

Brimstone 2009_3-3


STRAIGHT THROUGH CONFIGURATION
Used when acid gas is 50% H_2S or higher

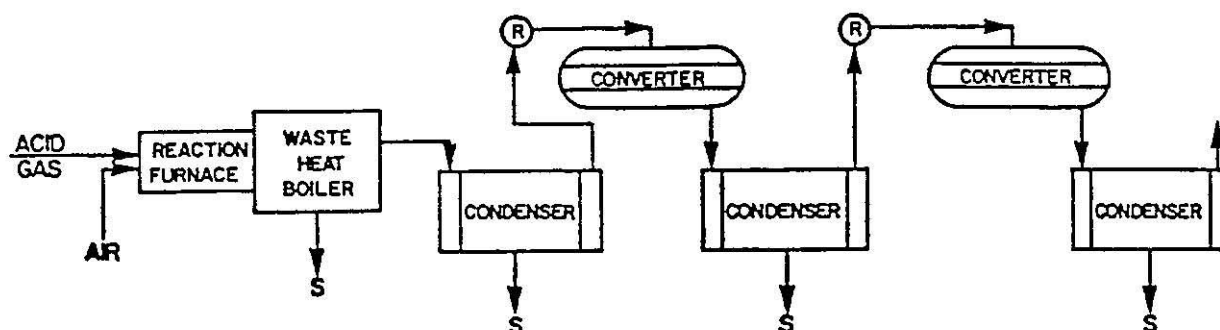


SPLIT FLOW CONFIGURATION
Used when acid gas is: 20-50% H_2S without preheat
-or-
10-25% H_2S with preheat

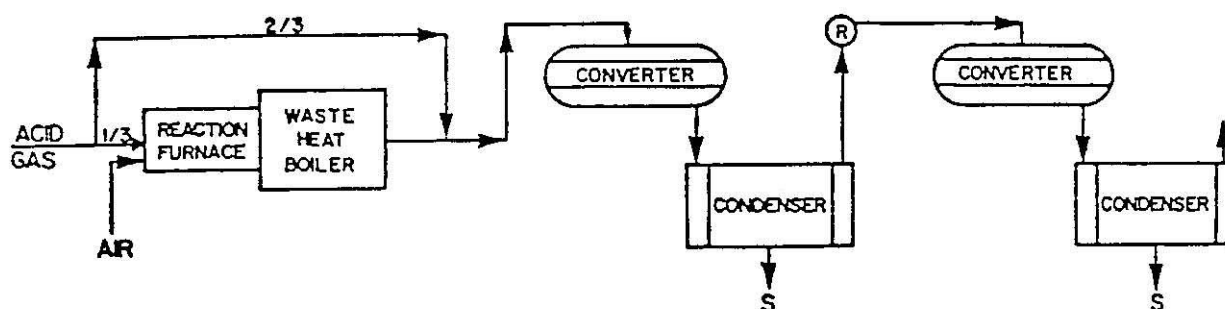


SULFUR RECYCLE CONFIGURATION
Used when acid gas is 10% H_2S or lower

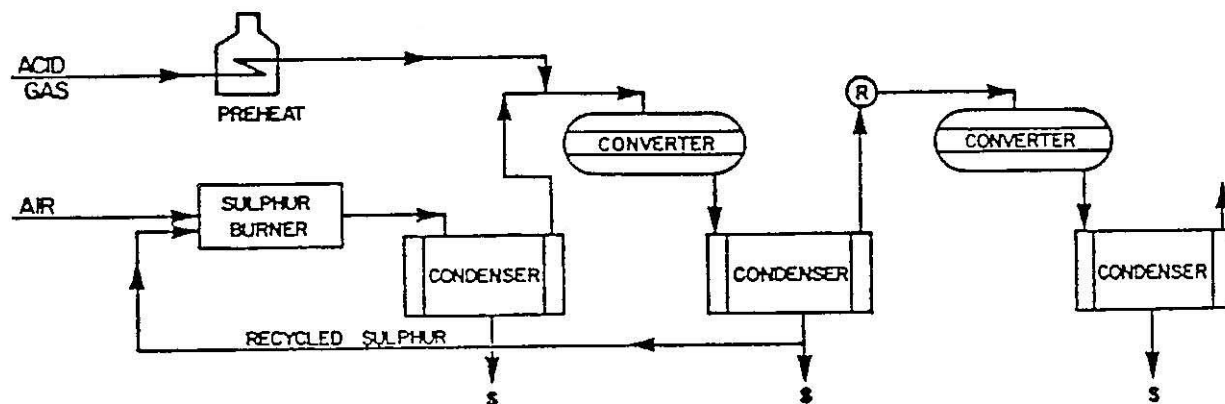

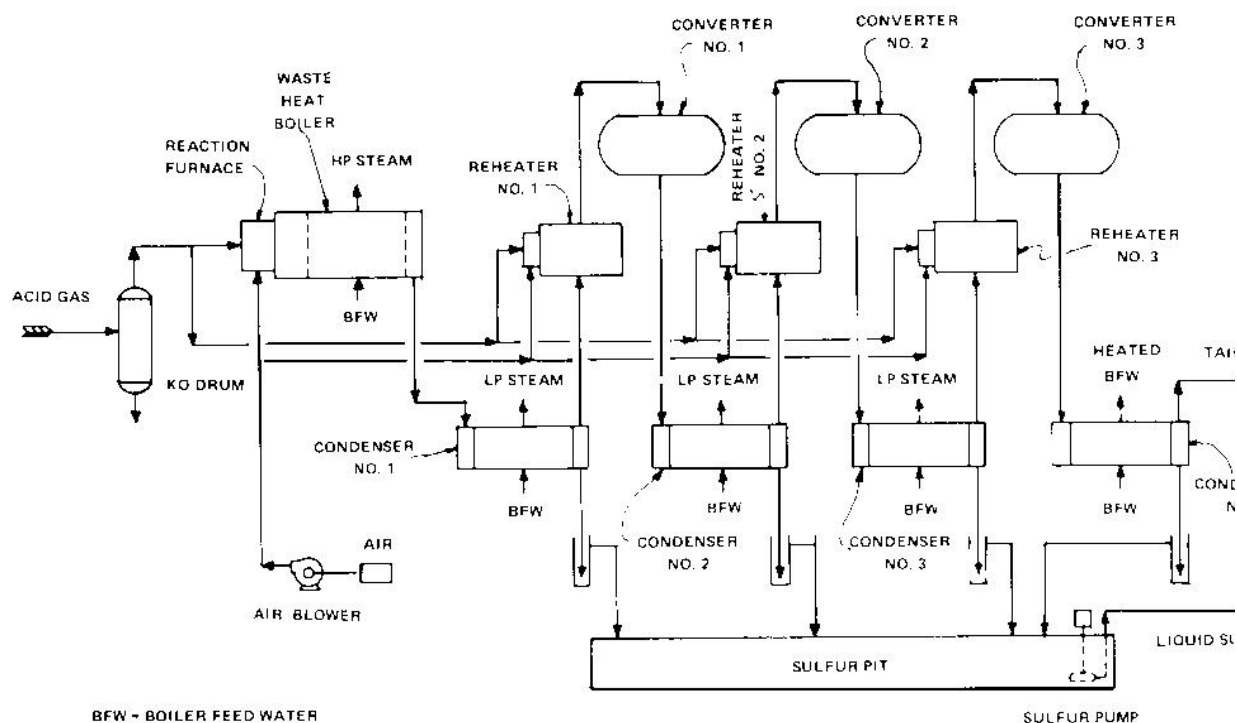


**Example of Three-Stage Sulfur Plant
(Straight-through operating with acid gas-fueled inline burners for reheating)**

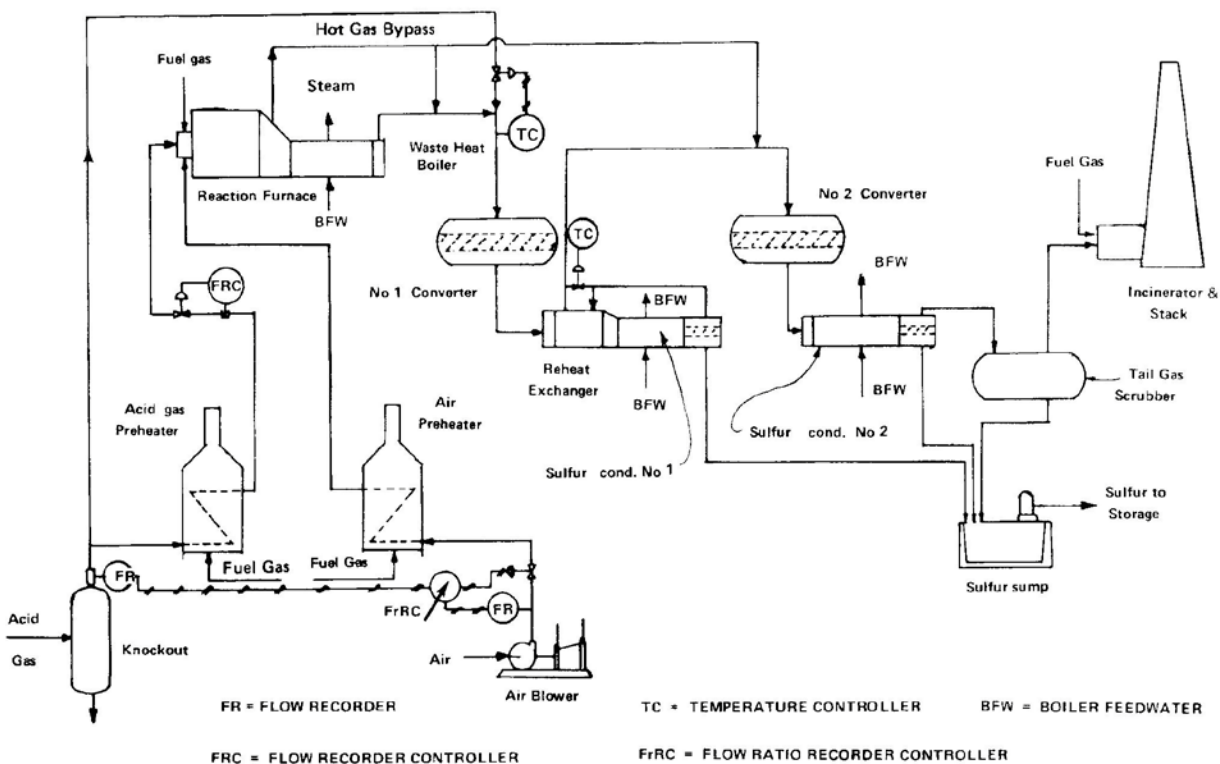


GPSA, 12th Edition 2004

Sulfur Recovery Process with Acid Gas and Air Preheat

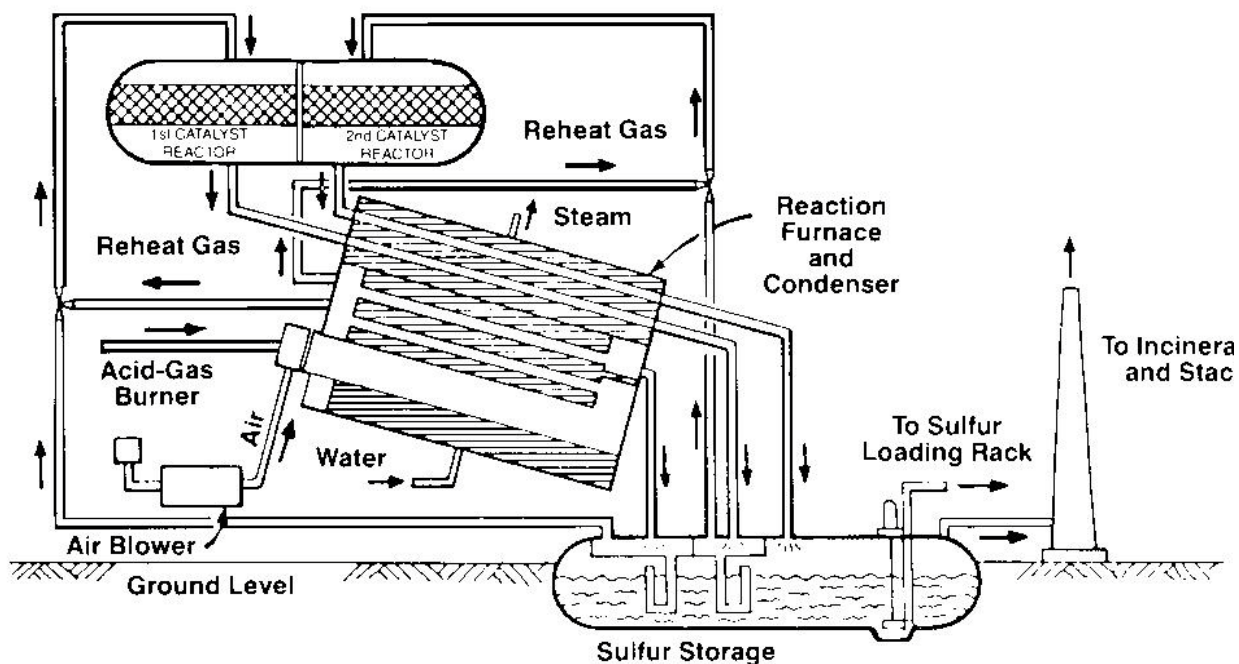


Example Package-Type Sulfur Plant

GPSA, 12th Edition 2004

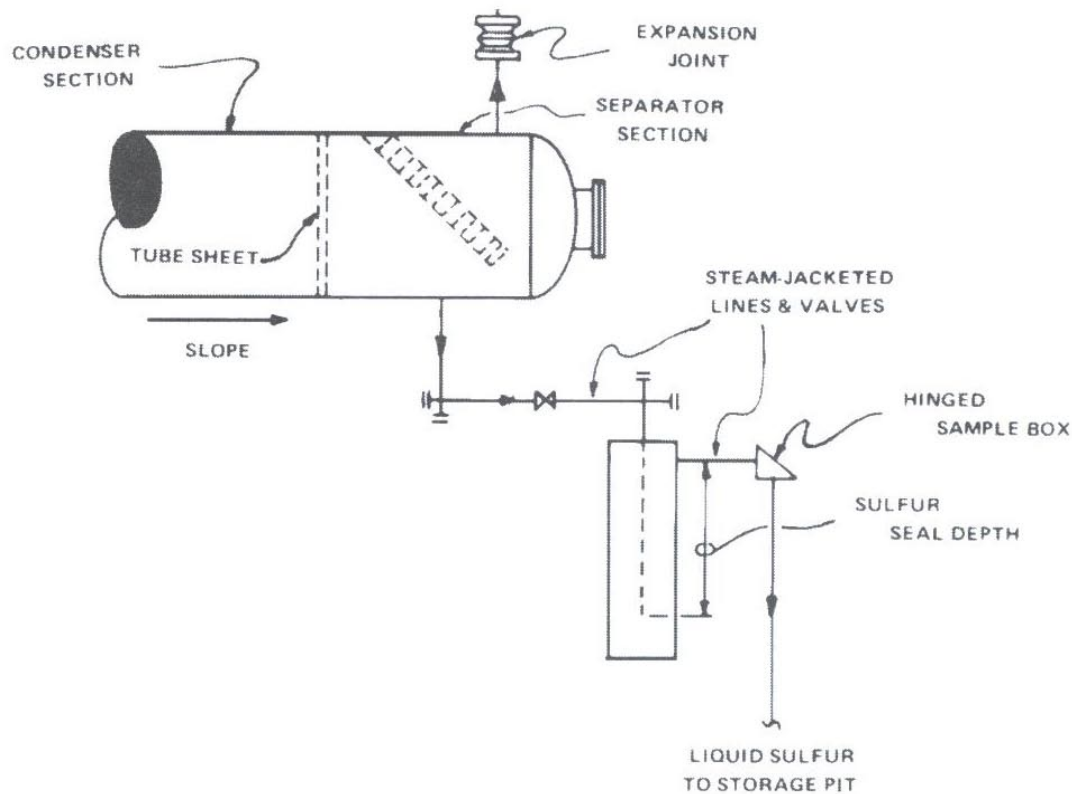


Typical Relationship of Sulfur Seal and Drain

GPSA, 12th Edition 2004
Brimstone 2009_3-6

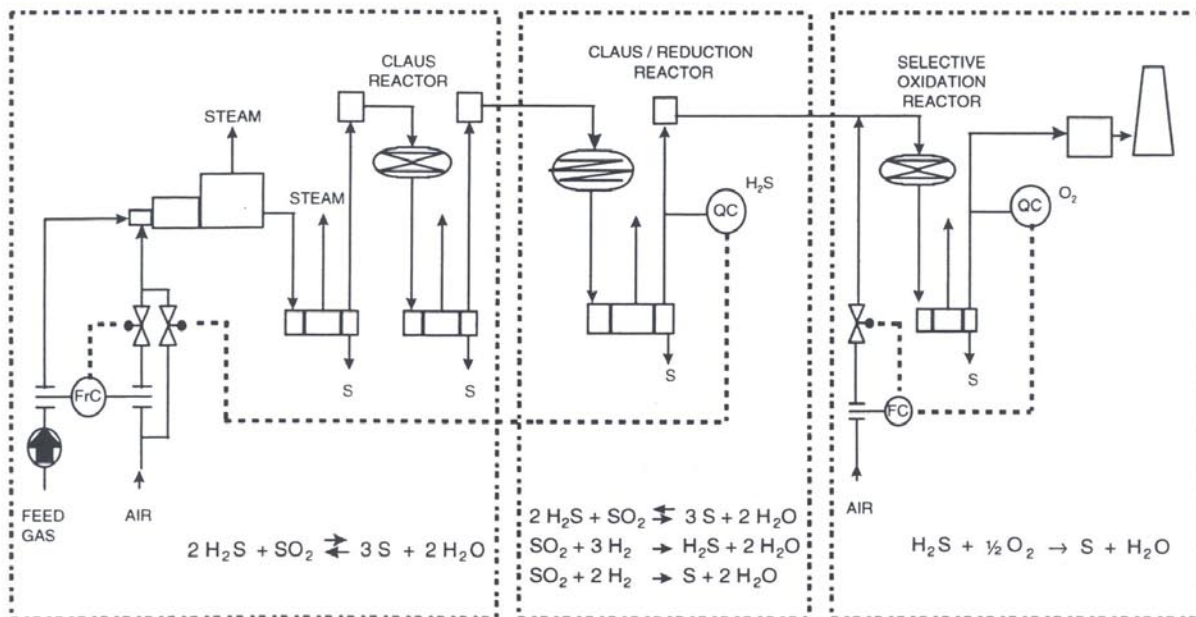


EUROCLAUS®

Borsboom, J., van Grinsven, M.M.M., and van Warners, A., Sulphur Recovery Further Improved by a Simple Continuous Process Called EUROCLAUS®
Brimstone Sulfur Symposium, Vail, Colorado USA, September 12-15, 2000.

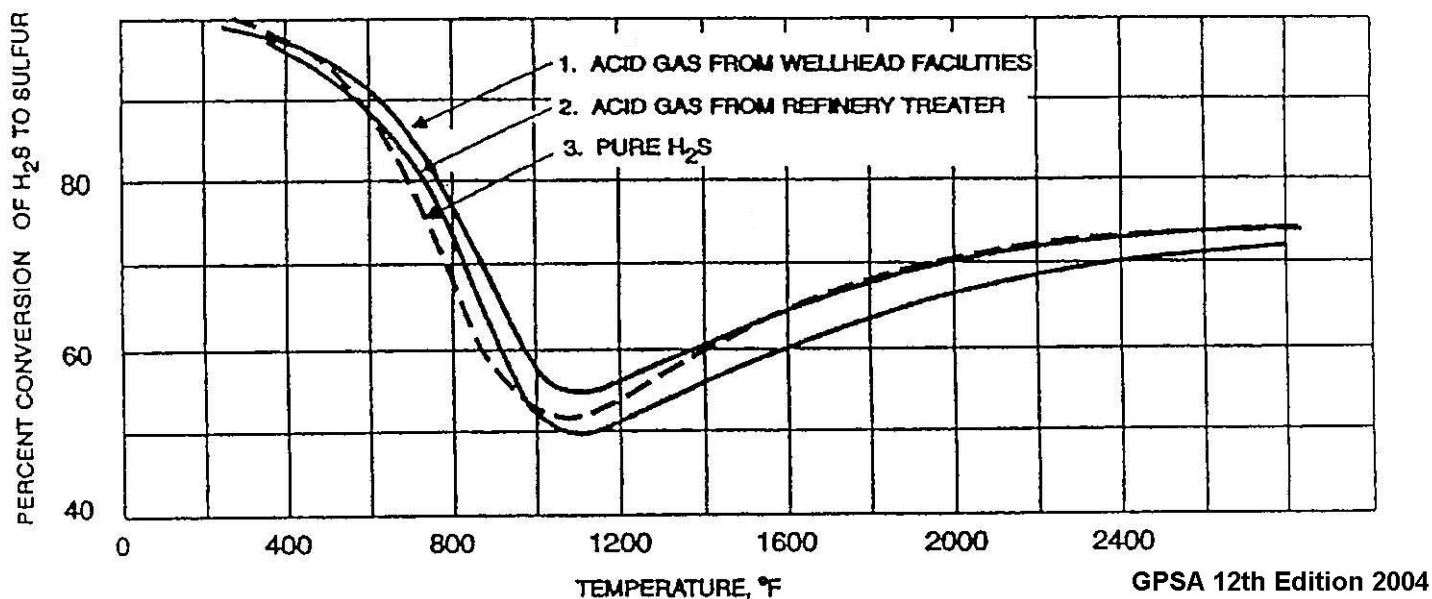


Theoretical Equilibrium Percent Conversion of Hydrogen Sulfide to Sulfur

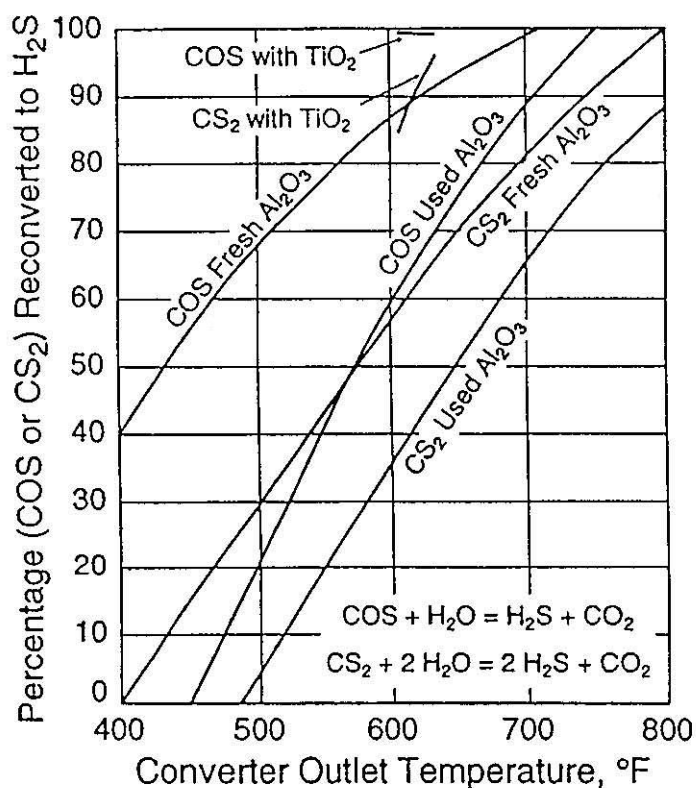


Hydrolysis of COS and CS₂ in Sulfur Converter
(Reproduced from GPSSA with permission)

GPSSA 12th Edition 2004


Filename: sup_f23_w_tio2.cdr
Brimstone 2009_3-8

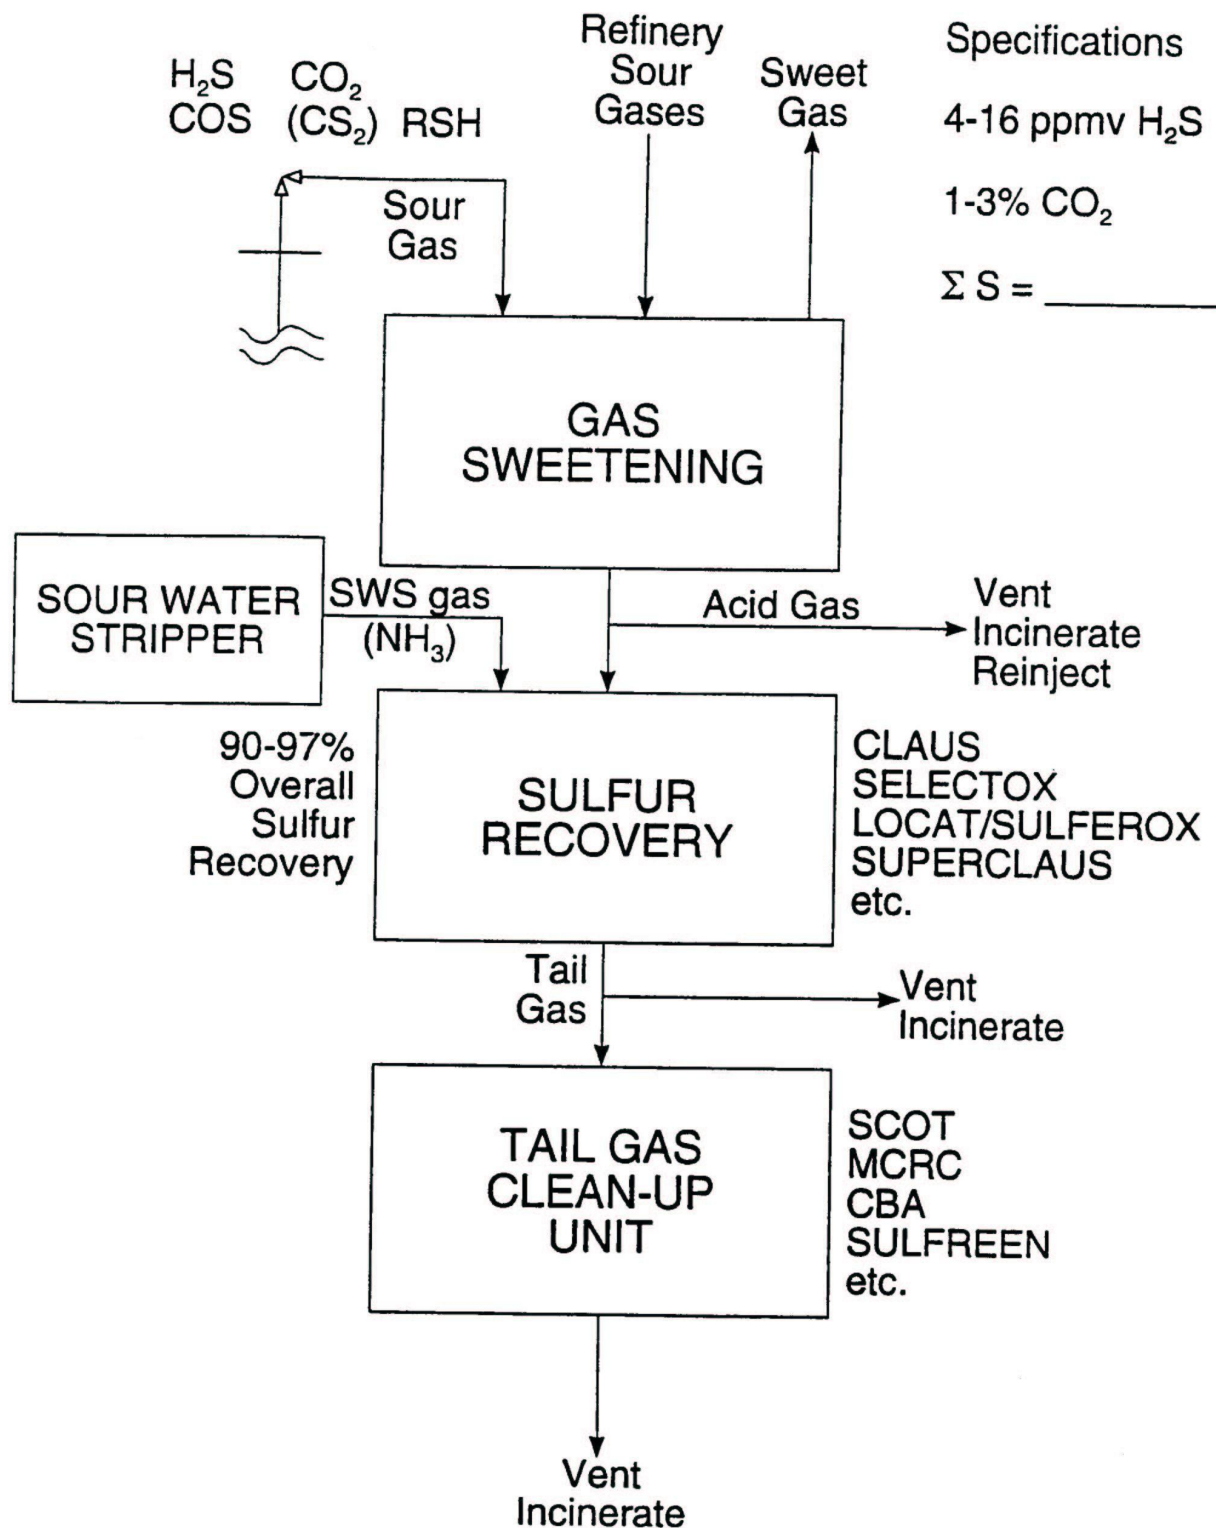

p:\djm_g6\pictures\g6_002.cdr

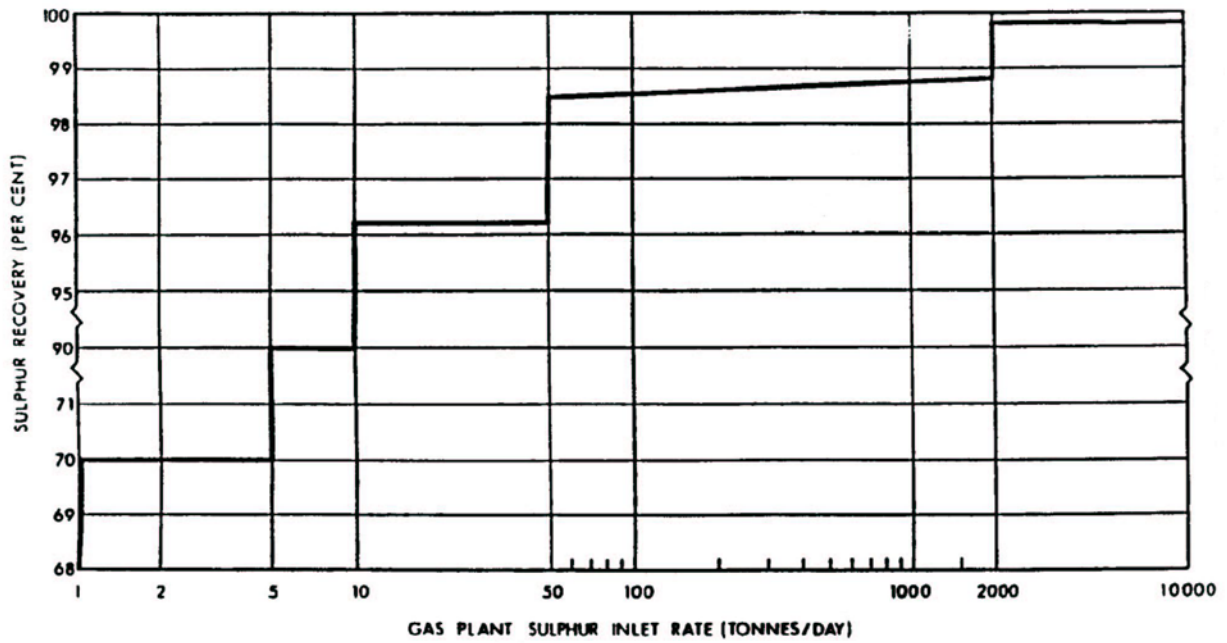

* At normal operating conditions, deduct 0.3% for quarterly average requirement.

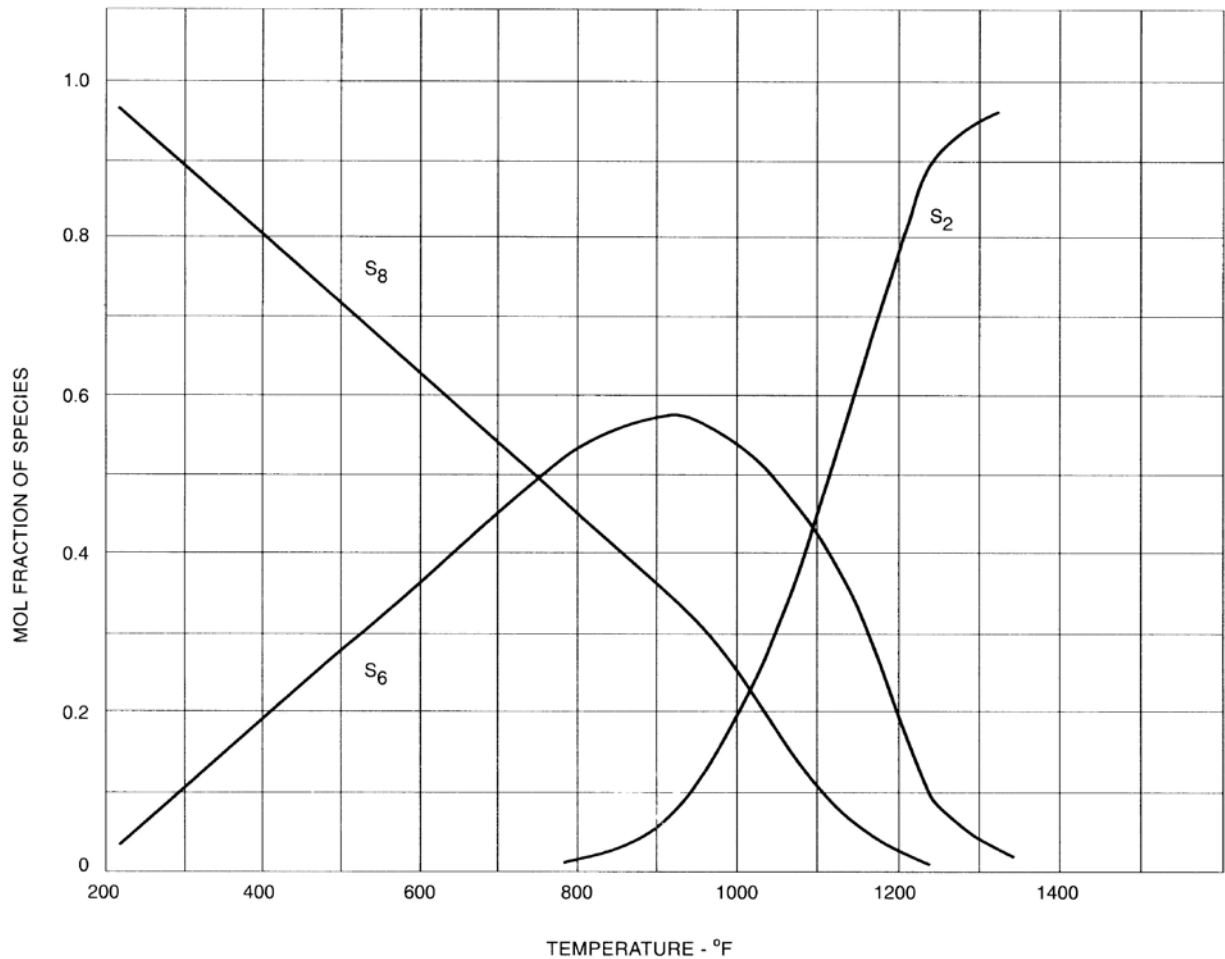


Distribution of Sulfur Vapor Species

GPSA 12th Edition 2004

Brimstone 2009_3-10

SULFUR RECOVERY

AIR REQUIREMENTS AND TAIL GAS COMPOSITION



A. Dry basis no hydrocarbons

Acid gas 15% CO₂
85% H₂S = 42.5 moles O₂ demand
100% or 100 mols

B. Dry basis but add 2% hc

O₂ demand

15	CO ₂		0
83	H ₂ S		41.5
1	CH ₄	C + O ₂ → CO ₂	2
		2H ₂ + O ₂ → 2H ₂ O	
1	C ₂ H ₆	2C + 2O ₂ → 2CO ₂	3.5
		3H ₂ + $\frac{3}{2}$ O ₂ → 3H ₂ O	
		5.5 O ₂ → 5H ₂ O + 3CO ₂	47.0

Note: 2% hydrocarbons caused a 10% increase in O₂ demand

C. Dry basis, 2% hc and 96% increase in O₂ demand

Of the 4% S not recovered as sulfur in the pit assume:

half is S_V + S_L + COS + CS₂
half is unreacted H₂S; SO₂

Thus example tail gas for 100 mols dry acid gas

15 + 3 (from hc) → CO ₂	18.0
83 × (0.96) H ₂ S + 39.8 O ₂ → H ₂ O	84.7 (incl. 5 H ₂ O from hc)
(39.8 + 5.2) O ₂ @ 21:79 O ₂ :N ₂ → N ₂	170.4
2% of the 83 H ₂ S is 1.6 mols S _V + S _L + COS + CS ₂	1.7 S ₁ equivalent
and 2% is unreacted H ₂ S, SO ₂	<u>1.7</u> S ₁ equivalent
	276.5 mols tail gas

Note: Tail gas volume is 2 ½ times acid gas
Tail gas is mainly N₂ and H₂O
Tail gas composition is approximately:

CO ₂	6.5
H ₂ O	30.6
N ₂	61.7
S _V + S _L + COS + CS ₂	0.6
H ₂ S, SO ₂	0.6
	100%

Tail gas will also contain H₂ & CO

Available Catalysts and Their Applications

		Surface Area	Macropore Volume, cc/g	Bulk Density	Average Crush Strength
Application		m ² /g	> 750 Å	lb/ft ³	lbs (5 mesh)
Standard Claus Catalyst**					
Alcan AA-400	Standard SRU's	295-350	0.12-0.19	45-49	16
BASF S-100	Standard SRU's	295-340	0.15-0.20	41-43	37
BASF S-400	Standard SRU's	300-350	0.15-0.20	41-43	37
BASF DD-431	Standard SRU's	350-400	0.16-0.21	39-42	35
Axens CR, 3x5 mesh	Standard SRU's	290	NR	42	45
Porocel Maxcel 727, 3x6 mesh	Standard SRU's	350-390	0.19-0.23	39-42	35
Promoted Alumina Catalysts for High COS, CS₂, Removal and/or Sulfation Resistance					
BASF DD-831	Higher COS	300	0.12	47	25
UOP S-501	Higher COS/CS ₂ Conversion	270	0.09	50	23
Axens CR 3S	Higher COS/CS ₂ Conversion	340	0.2	42	31
Axens CSM 31	Protection from BTEX	300	NR	47	20
Porocel Maxcel 747	Higher COS/CS ₂ Conversion	300	0.15	46	28
Axens AM***	O ₂ Scavenger/catalyst	280	NR	47	45
Porocel Maxcel 740***	O ₂ Scavenger/catalyst	310	0.1	43	40
BASF S-100SR***	O ₂ Scavenger/catalyst		0.1	45	35
Titania Catalyst for Ultra High CS₂ Conversion and Resistance to Sulfation Deactivation					
Axens CRS-31*		130	NR	54	28
UOP S-7001		260	NR	44	53
SRC-99ti*	Higher COS/CS ₂ Conversion	130	NR	52	25
DD-931 (4 mm)	Higher COS/CS ₂ Conversion	260	0.12	48	20
UOP TiO ₂ Catalyst S-7001					
Subdewpoint Catalysts					
Porocel Maxcel SD-C****	Subdewpoint SRU (carbon)	1000	n/a	31	5 kg/particle minimum
Porocel Maxcel SD-A	Subdewpoint SRU (alumina)	370	0.25-0.22 min ¹	38	35


*Extrudate

**Analyzed Samples


***Oxygen Scavenger

****Pellets

¹. Macroporosity > 750 Å°

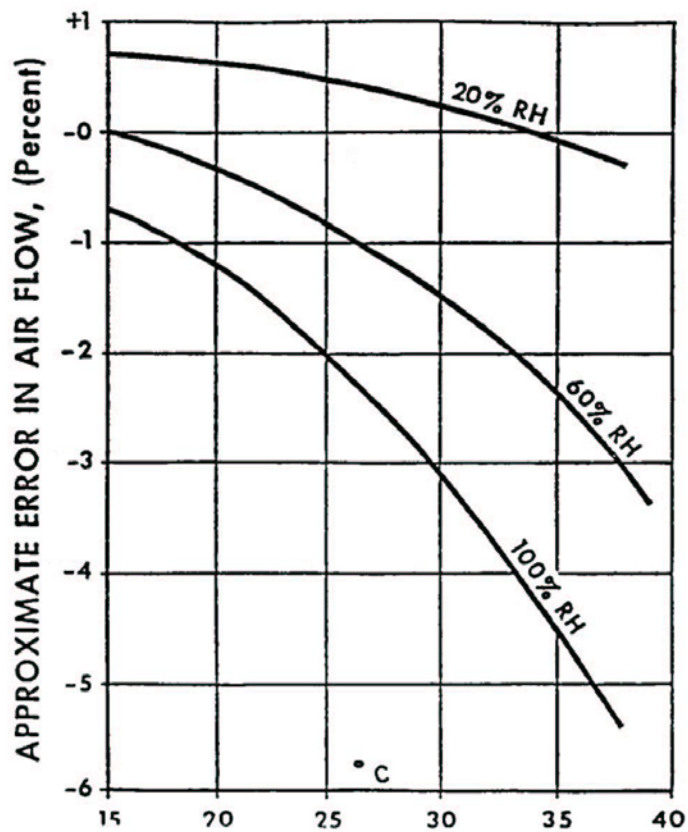

Approximate Error in Air Flow Based on Assumption of Constant 15.5° C Dry Bulb and 60% Relative Humidity

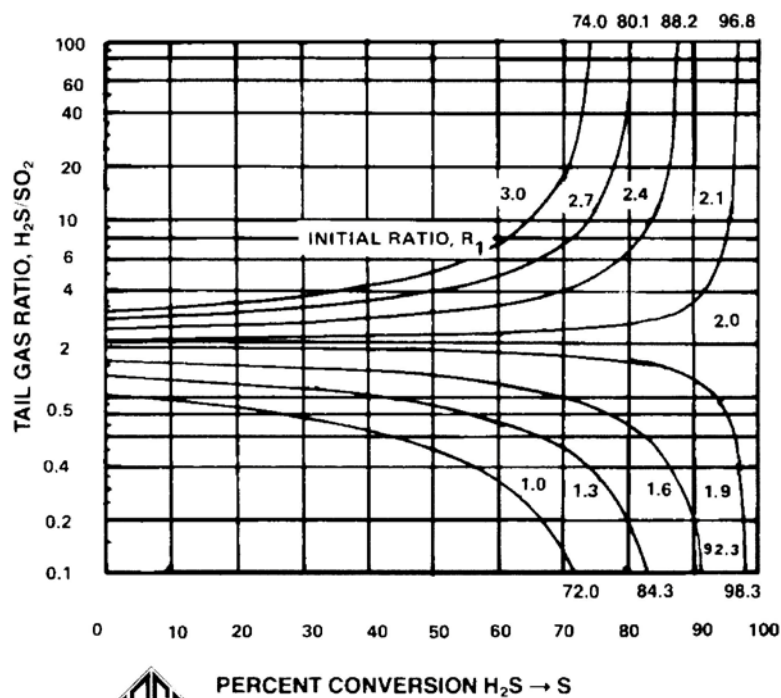


PERCENT CONVERSION $H_2S \rightarrow S$


GPSCA, 12th Edition 2004

Plot shows that a slight change in air to acid gas ratio at the head end of the plant will make a significant change in the Tail Gas Ratio, H_2S/SO_2

Brimstone 2009_3-13

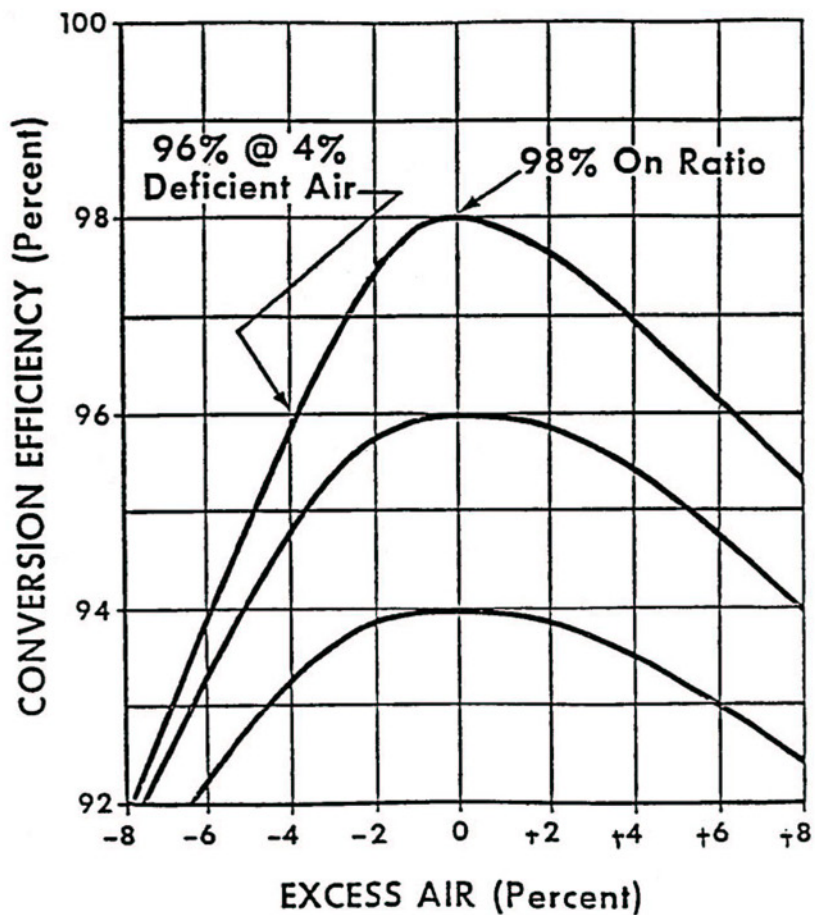

Efficiency Loss as a Function of Excess Reaction Air

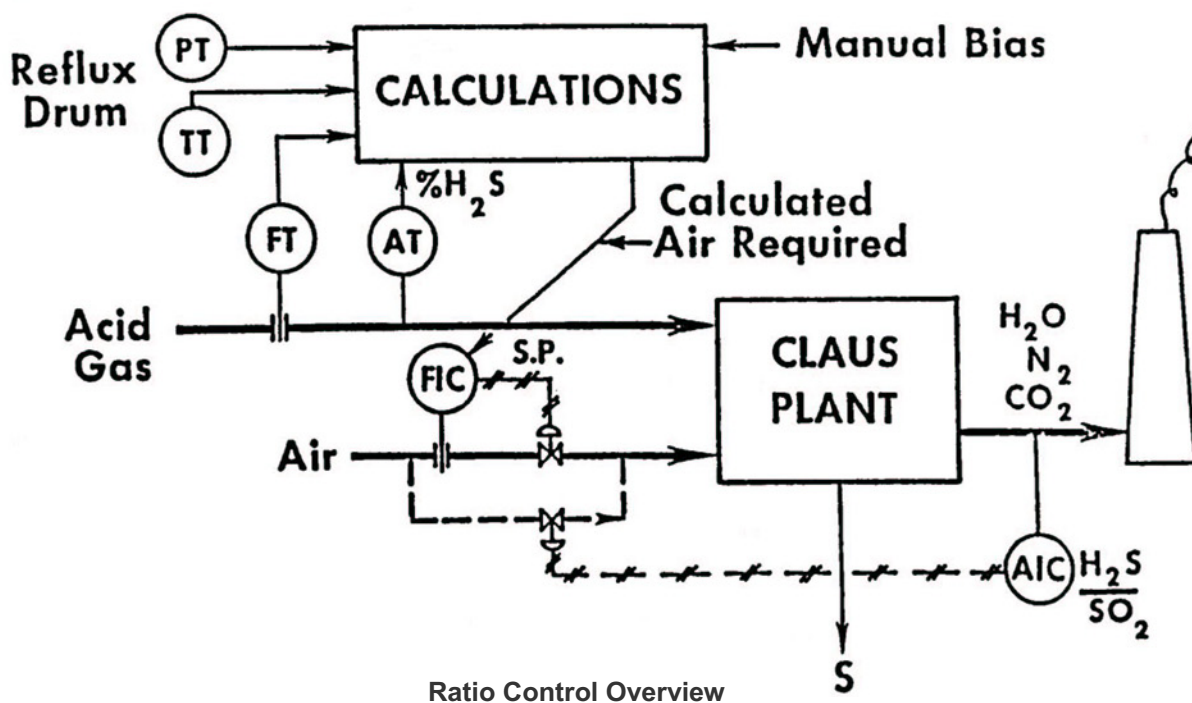

Brimstone 2009_3-14

SULFUR PRODUCT SPECIFICATIONS

A sulfur product meeting the following specifications will normally satisfy the requirements of the major consumers of sulfur such as manufacturers of sulfuric acid, chemicals, fertilizers, etc.:

Purity : 99.5%-99.8% by weight (dry basis)

Acidity (as H_2SO_4) : Less than 0.05% by weight

Moisture : Nil to 1.0% by weight

Ash : Less than 0.1% by weight


Carbonaceous Matter : Less than 0.15% by weight

Arsenic, Tellurium, Selenium : Commercially Free*

Color (see Note Below) : Bright yellow at ambient temperature

*Contents of less than 0.25 ppmw of arsenic and 2.0 ppmw of selenium and tellurium are usually considered as “commercially free”.


NOTE: The color of sulfur is an important property because it gives an immediate indication of product purity. The sulfur is a bright yellow if the impurity content is less than about 0.02% by weight. Small amounts of carbon (soot) change the bright yellow color to dull yellow or green; “dark” sulfur in which the yellow color has a shade of gray or brown usually contains 0.1%-0.5% by weight of carbon. For sulfuric acid manufacturers, however, sulfur color is usually less important than ash and heavy metal contents.

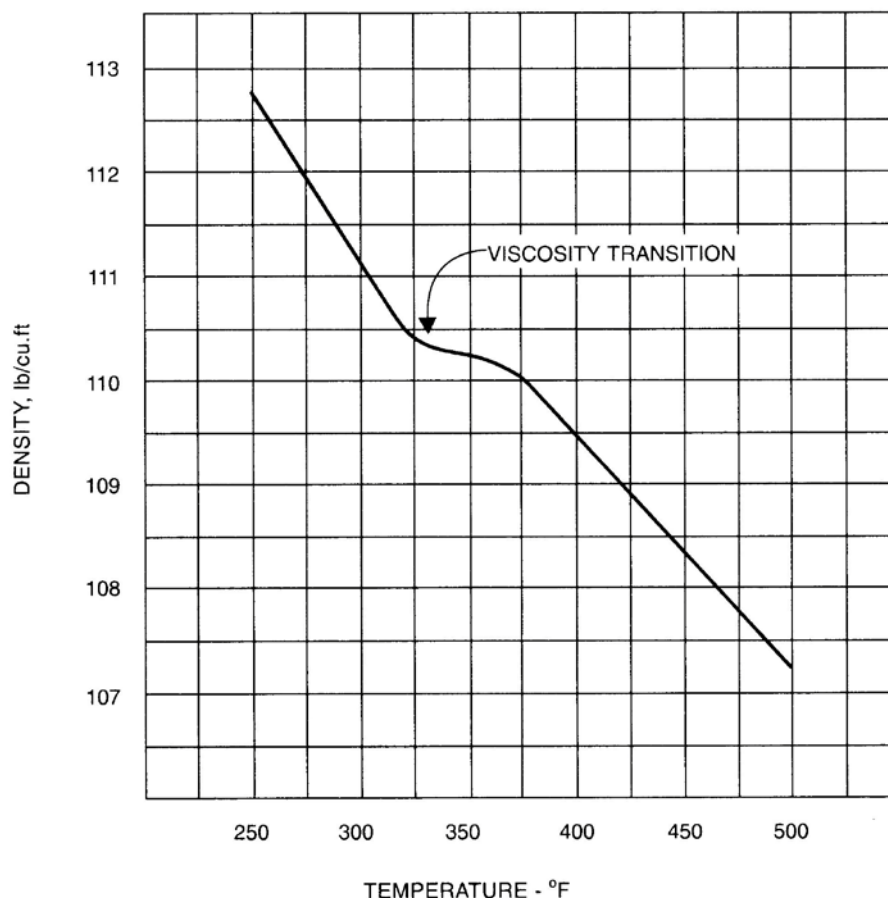

Density of Liquid Sulfur

GPSA 12th Edition 2004

Brimstone 2009_3-15

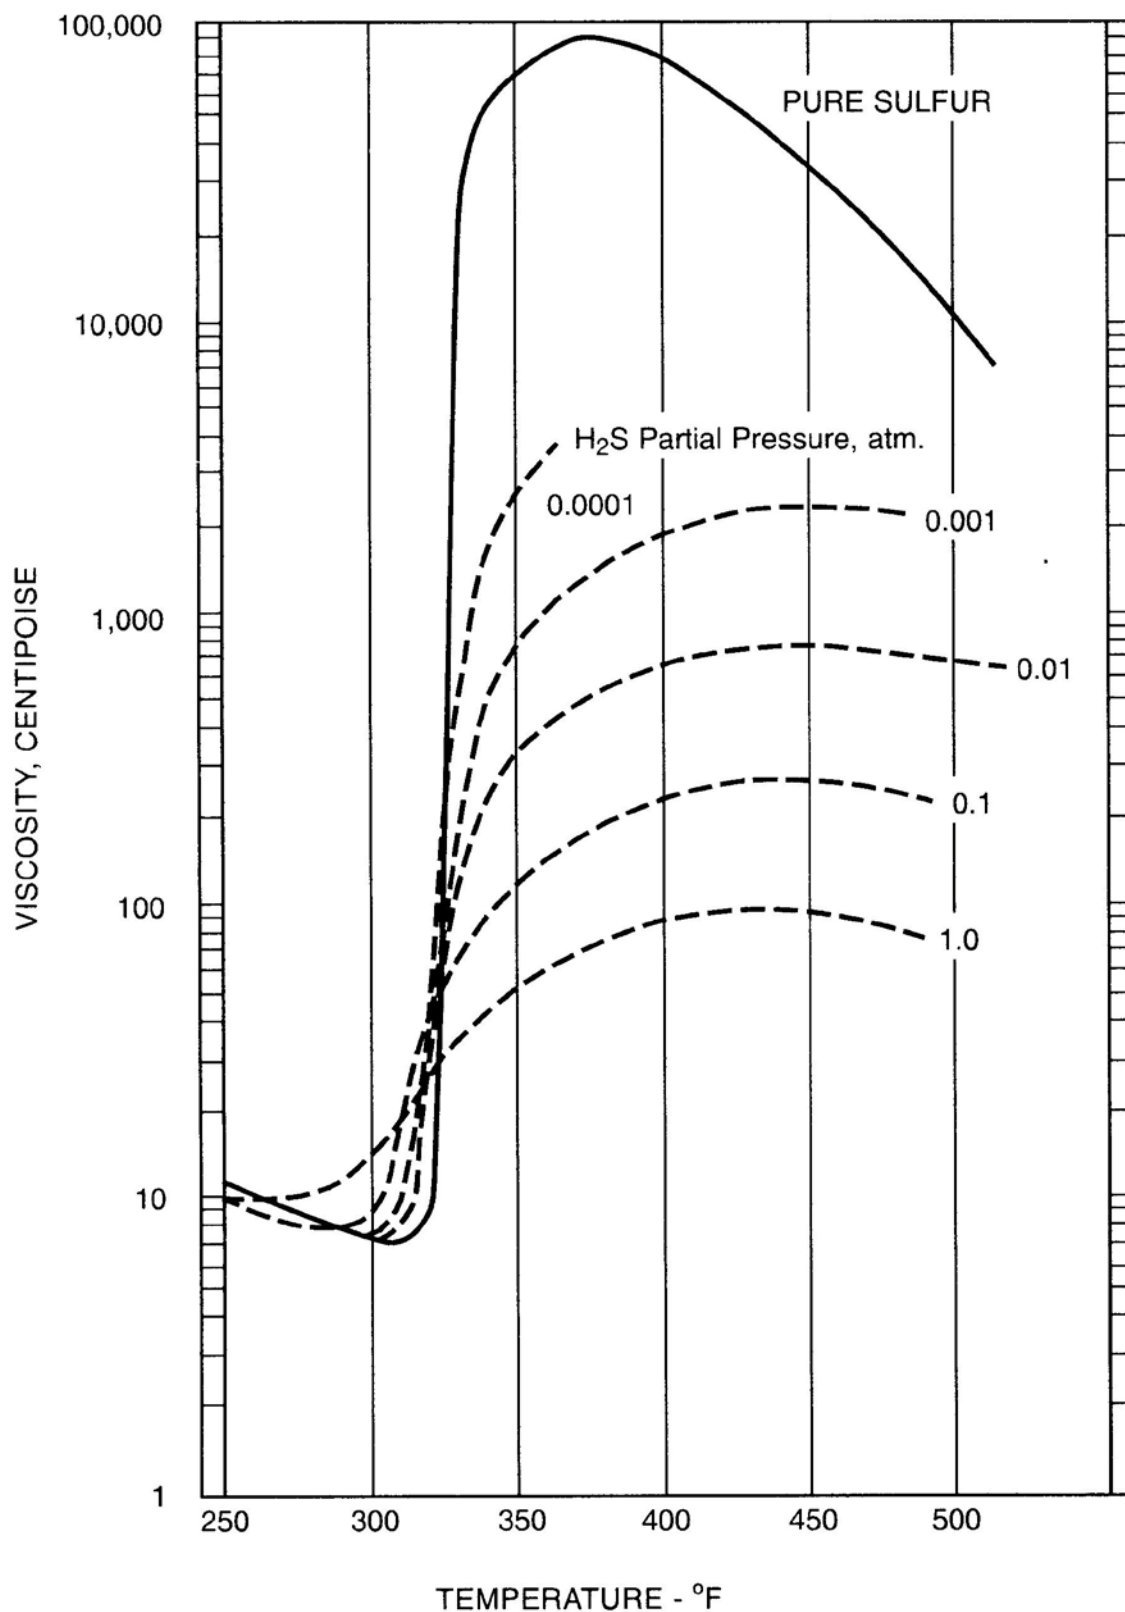

Effects of Hydrogen Sulfide on the Viscosity of Molten Sulfur

GPSA 12th Edition 2005

Brimstone 2009_3-16

SUPERCLAUS®

Direct – Oxidation reaction at end of Claus Process, 99% overall recovery

Normal Claus plant operation except the $\text{H}_2\text{S}:\text{SO}_2$ ratio is a little above 2:1 – that is an excess of H_2S .


The H_2S excess results in almost all of the SO_2 being consumed (leaving only 0.8-3.0 vol % H_2S along with other sulfur compounds such as COS, CS_2) after the second reactor.

Air is added ahead of the third reactor where direct oxidation of H_2S takes place:




There is no water removal in the process. The Superclaus catalyst appears to be insensitive to the water in the gas stream.


Reference: Lagas, J.A., Borsboom, J., & Berben, P.H., “The SuperClaus Process”, 38th Annual Laurance Reid Gas Conditioning Conference – Proceedings Addendum pp. 41-59, University of Oklahoma, Norman, Oklahoma, Mar. 7-9, 1988.

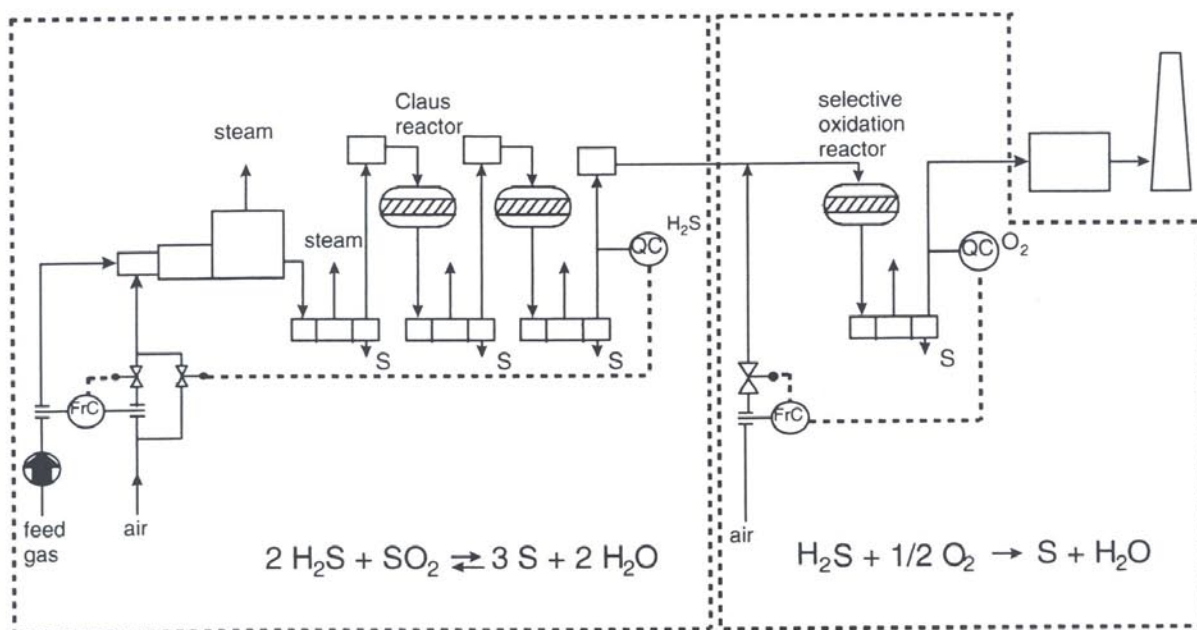


Brimstone 2009_3-17

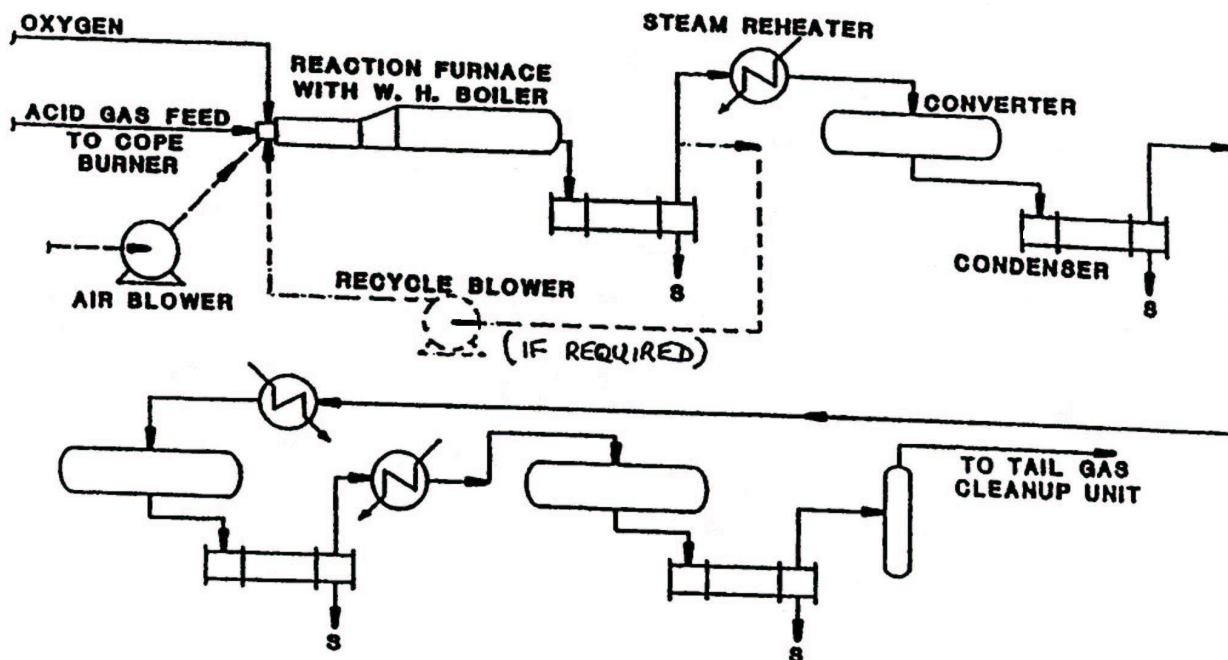

COPESM Sulfur Recovery Unit (Courtesy Goar, Allison & Assoc.)

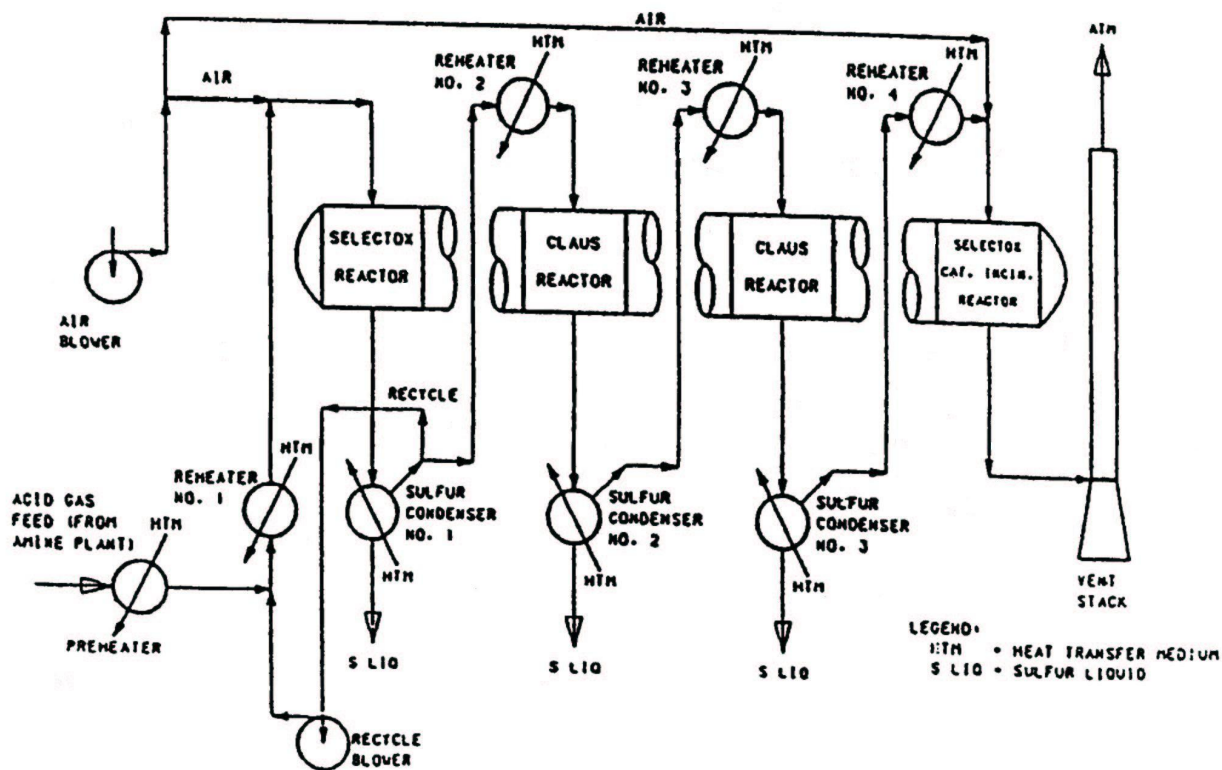

Recycle Selectox Sulfur Recovery Process (Courtesy B.G. Goar)

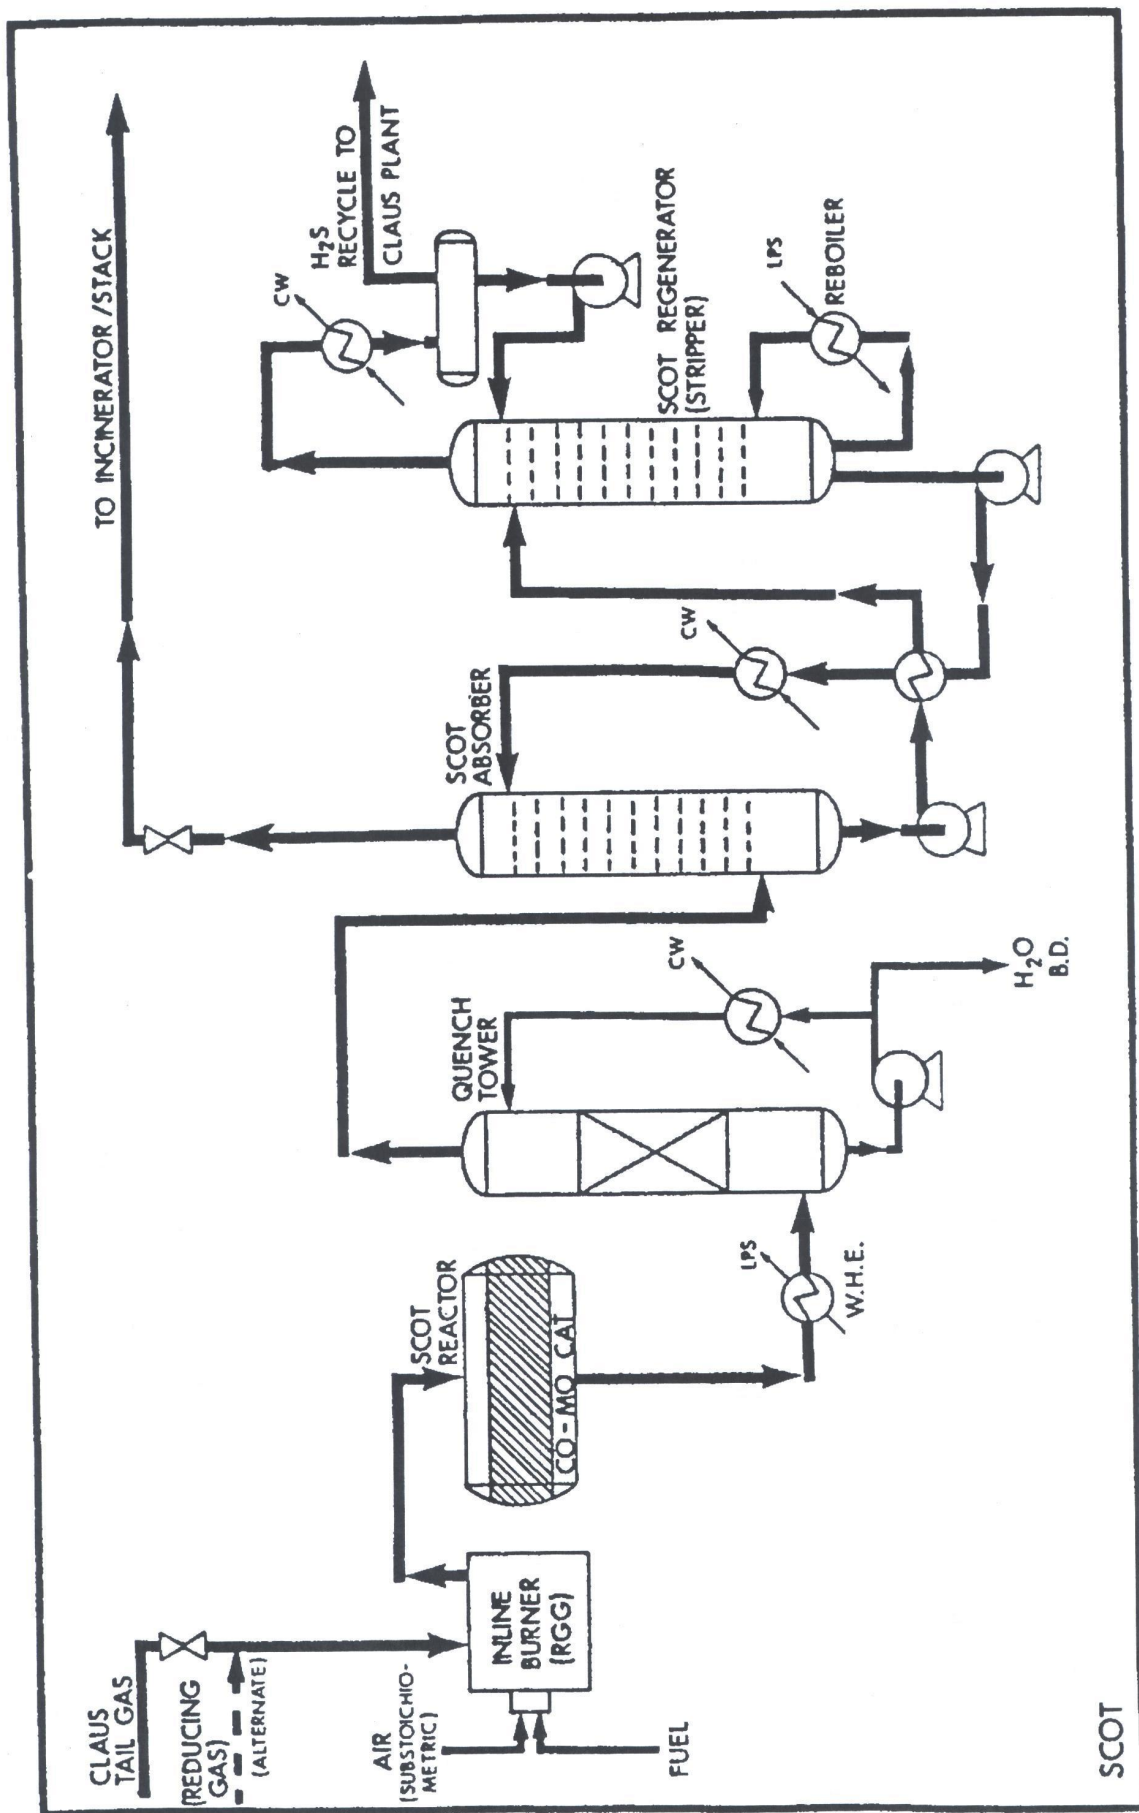

BRIMSTONE STS, LTD.

SULFUR RECOVERY

SYMPOSIUM

COMPUTER SIMULATION

This section contains an abbreviated output for a refinery sulfur plant simulation. It is a non-optimized run. The output is summarized on a completed run summary sheet that follows the output pages. A blank summary sheet is also provided for the use of attendees at their work locations.

The simulation was run on the Bryan Research and Engineering, Inc., (BRE Group, Ltd.) ProMax[®] program. This program also contains elements of the earlier TSWEET[®] program.

Bryan Research & Engineering, Inc.
P.O. Box 4747
Bryan, Texas 77805
TEL (979) 776-5220
FAX (979) 776-4818
www.bre.com

Gavin McIntyre
Manager, Process Applications/Customer Service
g.mcintyre@bre.com

Barry Burr
Technical Sales
b.burr@bre.com

EXAMPLE CLAUS PLANT SIMULATION

Bryan Research & Engineering, Inc – BR&E

ProMax® 2011

Copyright ©2002 2011 BRE Group, Ltd.


This is a non-optimized example simulation.

Contents of full output file:

PFD (only the enlarged page)	1 page	included here
All Streams (Individual stream props.)	7 pages	included here
Energy Stream Report	1 page	included here
Blocks	36 pages	not included
(Equipment, Simulation blocks, etc)		
Claus Beds		
Compressors (Blowers)		
Condensers		
Mixers		
Reactors		
Splitters		
Heat Exchangers		
Environment & Environment Reports		
(i.e. Simulation defaults etc.)	2 pages	not included here
Calculator Report	5 pages	not included here
User Value Sets Report	3 pages	not included here
Recoveries Report	11 pages	only p. 8 (of 11 included)
Energy Budgets Reports	3 pages	included here

File: Morgan_Refining_Claus_#1_TSWEET_Conversion-ProMax_defaults_rev2.docx

Morgan Refining Claus Train #1

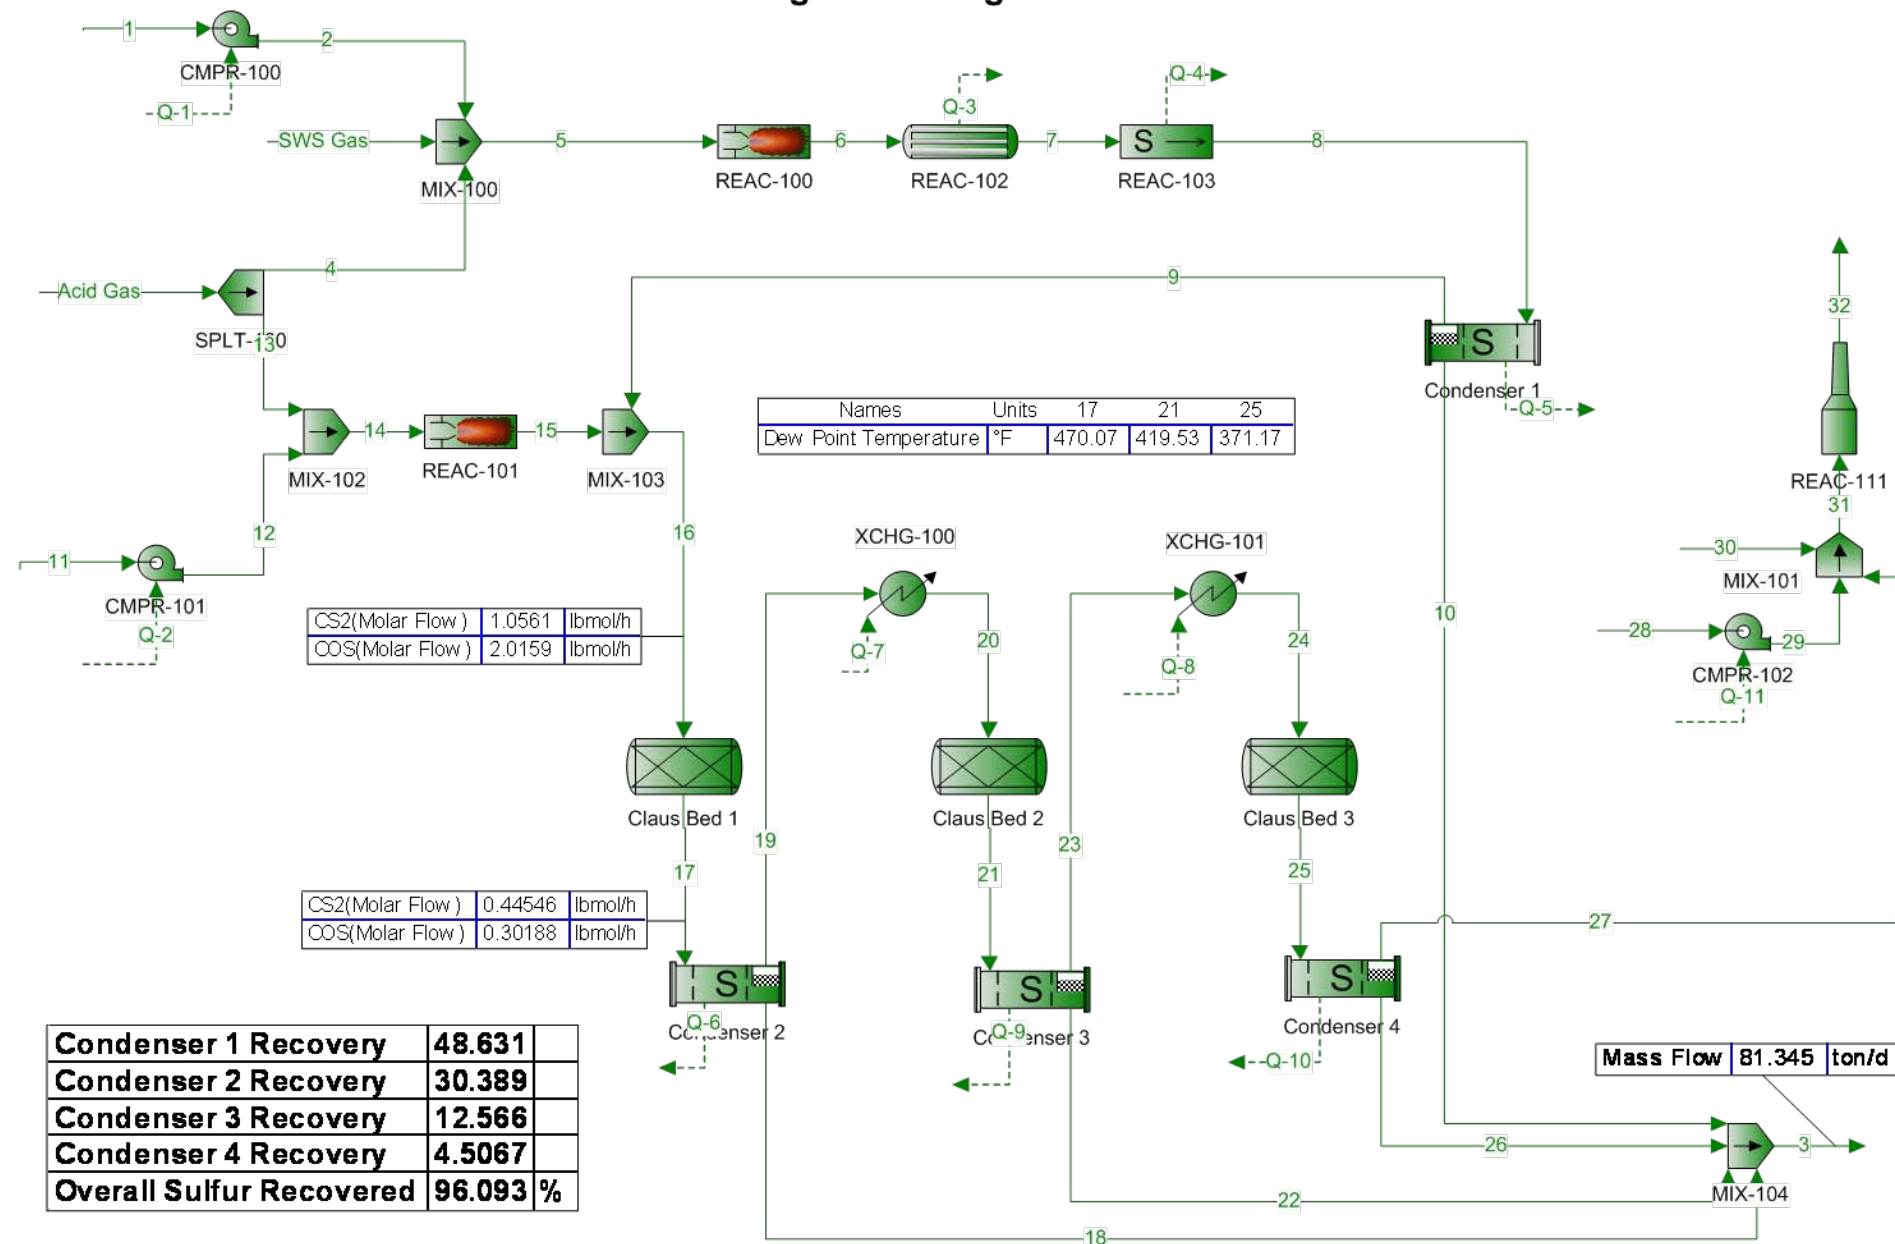

Process Streams Report

All Streams

Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	Acid Gas	SWS Gas	1	2	3
From Block	--	--	--	CMPR-100	MIX-104
To Block	SPLT-100	MIX-100	CMPR-100	MIX-100	--

Stream Composition

Molar Flow	Acid Gas lbmol/h	SWS Gas lbmol/h	1 lbmol/h	2 lbmol/h	3 lbmol/h
NH3	0 *	38 *	0 *	0	2.78352E-10
N2	4 *	2 *	551.178 *	551.178	4.7013E-06
H2S	170 *	50 *	0 *	0	0.0150922
CS2	0 *	0 *	0 *	0	1.55522E-06
COS	0 *	0 *	0 *	0	1.2255E-07
SO2	0 *	0 *	0 *	0	1.48621E-05
H2	0 *	0 *	0 *	0	3.06491E-07
CO	0 *	0 *	0 *	0	3.93296E-08
CO2	20 *	5 *	0 *	0	6.69678E-06
H2O	10.981 *	65.36 *	7.06638 *	7.06638	1.68358E-05
CH4	4 *	2.5 *	0 *	0	0
C2H6	2 *	1.5 *	0 *	0	0
C3H8	0 *	1 *	0 *	0	0
O2	0 *	0 *	148.394 *	148.394	4.73012E-14
S1	0 *	0 *	0 *	0	0
S2	0 *	0 *	0 *	0	0.0120172
S3	0 *	0 *	0 *	0	0.00137028
S4	0 *	0 *	0 *	0	0.00129891
S5	0 *	0 *	0 *	0	0.134459
S6	0 *	0 *	0 *	0	4.69615
S7	0 *	0 *	0 *	0	2.71822
S8	0 *	0 *	0 *	0	20.435

Stream Properties

Property	Units	Acid Gas	SWS Gas	1	2	3
Temperature	°F	110 *	195 *	70 *	177.047	370.436
Pressure	psia	25 *	23 *	14.6959 *	22.7 *	17.5
Mole Fraction Vapor	%	99.9703	100	100	100	0
Mole Fraction Light Liquid	%	0.0297399	0	0	0	100
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	33.6908	23.7909	28.7504	28.7504	241.98
Mass Density	lb/ft^3	0.139299	0.0786376	0.0743637	0.0955041	110.015
Molar Flow	lbmol/h	210.981	165.36	706.638 *	706.638	28.0136
Mass Flow	lb/h	7108.13	3934.06	20316.1	20316.1	6778.73
Vapor Volumetric Flow	ft^3/h	51028	50027.8	273199	212725	61.6166
Liquid Volumetric Flow	gpm	6361.93	6237.23	34061.2	26521.5	7.68207
Std Vapor Volumetric Flow	MMSCFD	1.92154	1.50604	6.4358	6.4358	0.255138
Std Liquid Volumetric Flow	sgpm	18.09	10.0852	46.8184	46.8184	7.1693
Compressibility		0.989049	0.990426	0.999563	1.00008	0.00432084
Specific Gravity			0.821435	0.992672	0.992672	1.76393
API Gravity						-55.5716
Enthalpy	Btu/h	-6.18169E+06	-8.8543E+06	-771853	-242747	640227
Mass Enthalpy	Btu/lb	-869.665	-2250.68	-37.9922	-11.9485	94.4464
Mass Cp	Btu/(lb*°F)	0.249993	0.365115	0.2443294	0.244453	0.306561
Ideal Gas CpCv Ratio		1.31286	1.29989	1.3977	1.39514	1.05485
Dynamic Viscosity	cP		0.0141661	0.0181119	0.0208487	350.883
Kinematic Viscosity	cSt		11.2461	15.2048	13.6282	199.109
Thermal Conductivity	Btu/(h*ft*°F)		0.0140076	0.0146553	0.0171165	0.0864803 ?
Surface Tension	lbf/ft					0.00377062

Remarks

Process Streams Report

All Streams

Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	4	5	6	7	8
From Block	SPLT-100	MIX-100	REAC-100	REAC-102	REAC-103
To Block	MIX-100	REAC-100	REAC-102	REAC-103	Condenser 1

Stream Composition

Molar Flow	4 lbmol/h	5 lbmol/h	6 lbmol/h	7 lbmol/h	8 lbmol/h
NH3	0	38	0.000517257	5.01279E-05	5.01279E-05
N2	3.85176	557.029	576.029	576.029	576.029
H2S	163.7	213.7	39.0048	58.7086	58.7086
CS2	0	0	0.765404	0.765404	0.765404
COS	0	0	1.86752	1.86752	1.86752
SO2	0	0	32.4063	26.0957	26.0957
H2	0	0	44.3541	18.2211	18.2211
CO	0	0	11.3547	5.16327	5.16327
CO2	19.2588	24.2588	26.4747	32.6661	32.6661
H2O	10.574	83.0004	297.322	303.752	303.752
CH4	3.85176	6.35176	1.42161E-08	0	0
C2H6	1.92588	3.42588	0	0	0
C3H8	0	1	0	0	0
O2	0	148.394	5.3431E-07	0	0
S1	0	0	0.0179213	1.58295E-07	0
S2	0	0	69.2591	58.8795	0.521527
S3	0	0	0.117131	1.6989	0.0558054
S4	0	0	0.000725843	0.211212	0.0356001
S5	0	0	9.34156E-06	0.159233	0.603936
S6	0	0	1.75043E-07	0.128326	6.12133
S7	0	0	2.8295E-09	0.0287913	3.99767
S8	0	0	0	0.00361437	7.05162

Stream Properties

Property	Units	4	5	6	7	8
Temperature	°F	110	165.318	2350.87	1200 *	640 *
Pressure	psia	25	22.7	22.2	21.7	21.1
Mole Fraction Vapor	%	99.9703	100	100	100	100
Mole Fraction Light Liquid	%	0.0297399	0	0	0	0
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	33.6908	28.9211	28.2944	28.6753	29.8514
Mass Density	lb/ft^3	0.139299	0.0980587	0.0208216	0.0349325	0.0533839
Molar Flow	lbmol/h	203.162	1075.16	1098.97	1084.38	1041.66
Mass Flow	lb/h	6844.7	31094.9	31094.9	31094.9	31094.9
Vapor Volumetric Flow	ft^3/h	49136.9	317105	1.49339E+06	890140	582476
Liquid Volumetric Flow	gpm	6126.16	39535.1	186189	110979	72620.4
Std Vapor Volumetric Flow	MMSCFD	1.85032	9.79216	10.009	9.87612	9.48702
Std Liquid Volumetric Flow	sgpm	17.4196	74.3232	68.1873	67.8078	67.8078
Compressibility		0.989049	0.998204	1.0002	1.00012	0.999792
Specific Gravity			0.998568	0.97693	0.99008	1.03069
API Gravity						
Enthalpy	Btu/h	-5.95259E+06	-1.50496E+07	-1.50496E+07	-2.80308E+07	-3.56162E+07
Mass Enthalpy	Btu/lb	-869.665	-483.991	-483.991	-901.461	-1145.4
Mass Cp	Btu/(lb*°F)	0.249993	0.260901	0.343135	0.305384	0.28559
Ideal Gas CpCv Ratio		1.31286	1.35906	1.25717	1.29349	1.30413
Dynamic Viscosity	cP		0.0186917	0.0558029 ?	0.0377523 ?	0.0287486 ?
Kinematic Viscosity	cSt		11.8999	167.31 ?	67.4672 ?	33.6191 ?
Thermal Conductivity	Btu/(h*ft*°F)		0.0155221	0.066291 ?	0.0389336 ?	0.0272716 ?
Surface Tension	lb/ft					

Remarks

Process Streams Report

All Streams

Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	9	10	11	12	13
From Block	Condenser 1	Condenser 1	--	CMPR-101	SPLT-100
To Block	MIX-103	MIX-104	CMPR-101	MIX-102	MIX-102

Stream Composition

Molar Flow	9 lbmol/h	10 lbmol/h	11 lbmol/h	12 lbmol/h	13 lbmol/h
NH3	5.01278E-05	1.30362E-10	0 *	0	0
N2	576.029	3.176E-06	27.8743 *	27.8743	0.148239
H2S	58.6965	0.0121452	0 *	0	6.30016
CS2	0.765403	1.06181E-06	0 *	0	0
COS	1.86752	1.11344E-07	0 *	0	0
SO2	26.0957	1.13146E-05	0 *	0	0
H2	18.2211	2.02793E-07	0 *	0	0
CO	5.16327	2.64997E-08	0 *	0	0
CO2	32.6661	3.84331E-06	0 *	0	0.741196
H2O	303.752	8.3285E-06	0.357362 *	0.357362	0.406953
CH4	0	0	0 *	0	0.148239
C2H6	0	0	0 *	0	0.0741196
C3H8	0	0	0 *	0	0
O2	0	0	7.50461 *	7.50461	0
S1	0	0	0 *	0	0
S2	0.00140072	0.00812169	0 *	0	0
S3	0.00016384	0.000949276	0 *	0	0
S4	0.000154843	0.000896514	0 *	0	0
S5	0.0139492	0.0807075	0 *	0	0
S6	0.43742	2.52912	0 *	0	0
S7	0.268676	1.55243	0 *	0	0
S8	1.74282	10.0635	0 *	0	0

Stream Properties

Property	Units	9	10	11	12	13
Temperature	°F	400 *	400	70 *	180.48	110
Pressure	psia	20.7	20.7	14.6959 *	23 *	25
Mole Fraction Vapor	%	100	0	100	100	99.9703
Mole Fraction Light Liquid	%	0	100	0	0	0.0297399
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	26.9705	240.779	28.7504	28.7504	33.6908
Mass Density	lb/ft^3	0.0605605	109.399	0.0743637	0.0962456	0.139299
Molar Flow	lbmol/h	1025.72	14.2479	35.7362 *	35.7362	7.81891 *
Mass Flow	lb/h	27664.3	3430.59	1027.43	1027.43	263.426
Vapor Volumetric Flow	ft^3/h	456803	31.3585	13816.3	10675.1	1891.09
Liquid Volumetric Flow	gpm	56952.1	3.90963	1722.55	1330.92	235.772
Std Vapor Volumetric Flow	MMSCFD	9.34189	0.129764	0.325472	0.325472	0.0712117
Std Liquid Volumetric Flow	sgpm	64.1793	3.62847	2.36771	2.36771	0.670411
Compressibility		0.999251	0.00493833	0.999563	1.0001	0.989049
Specific Gravity		0.93122	1.75406	0.992672	0.992672	
API Gravity			-55.5808			
Enthalpy	Btu/h	-3.86201E+07	354444	-39034.3	-11415.5	-229092
Mass Enthalpy	Btu/lb	-1396.03	103.319	-37.9922	-11.1108	-869.665
Mass Cp	Btu/(lb*°F)	0.291717	0.293227	0.243294	0.2445	0.249993
Ideal Gas CpCv Ratio		1.33845	1.05485	1.3977	1.39503	1.31286
Dynamic Viscosity	cP	0.0236532	442.467	0.0181119	0.0209332	
Kinematic Viscosity	cSt	24.3825	252.492	15.2048	13.578	
Thermal Conductivity	Btu/(h*ft*°F)	0.022038	0.0909103 ?	0.0146553	0.0171937	
Surface Tension	lbf/ft		0.00370579			

Remarks

* User Specified Values

? Extrapolated or Approximate Values

ProMax 3.2.11188.0
Copyright © 2002-2011 BRE Group, Ltd.

Licensed by Bryan Research & Engineering, Inc.

Process Streams Report All Streams Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	14	15	16	17	18
From Block	MIX-102	REAC-101	MIX-103	Claus Bed 1	Condenser 2
To Block	REAC-101	MIX-103	Claus Bed 1	Condenser 2	MIX-104

Stream Composition

Molar Flow	14 lbmol/h	15 lbmol/h	16 lbmol/h	17 lbmol/h	18 lbmol/h
NH3	0	3.70132E-06	5.38291E-05	5.38291E-05	9.14788E-11
N2	28.0225	28.0225	604.052	604.052	1.19951E-06
H2S	6.30016	0.0740734	58.7706	24.9943	0.00259079
CS2	0	0.290704	1.05611	0.445463	3.35619E-07
COS	0	0.148387	2.0159	0.301875	8.17838E-09
SO2	0	4.75577	30.8514	12.4957	3.03465E-06
H2	0	0.88721	19.1083	19.1083	8.04793E-08
CO	0	0.223292	5.38657	5.38657	1.00594E-08
CO2	0.741196	0.375291	33.0414	35.3661	2.01972E-06
H2O	0.764316	6.62203	310.374	344.15	5.50991E-06
CH4	0.148239	0	0	0	0
C2H6	0.0741196	0	0	0	0
C3H8	0	0	0	0	0
O2	7.50461	5.13048E-05	5.13048E-05	2.56524E-06	4.67964E-14
S1	0	0.0069068	0.0069068	0.00034534	0
S2	0	0.36666	0.36806	0.306026	0.0030232
S3	0	0.000101013	0.000264852	0.0295141	0.000332943
S4	0	0	0.000154843	0.0184978	0.000317858
S5	0	0	0.0139492	0.34333	0.0386034
S6	0	0	0.43742	3.64957	1.44613
S7	0	0	0.268676	2.25305	0.811653
S8	0	0	1.74282	4.27111	6.5368

Stream Properties

Property	Units	14	15	16	17	18
Temperature	°F	165.359	3044.17	518.202	610.04	360
Pressure	psia	23	22.9	20.7	20.3	19.9
Mole Fraction Vapor	%	100	100	100	100	0
Mole Fraction Light Liquid	%	0	0	0	0	100
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	29.6373	30.9017	27.1244	27.3892	242.522
Mass Density	lb/ft^3	0.101699	0.0188153	0.0535217	0.0484433	110.231
Molar Flow	lbmol/h	43.5551	41.773	1067.49	1057.17	8.83946
Mass Flow	lb/h	1290.85	1290.85	28955.1	28955.1	2143.76
Vapor Volumetric Flow	ft^3/h	12692.9	68606.7	540998	597711	19.448
Liquid Volumetric Flow	gpm	1582.5	8553.56	67449	74519.9	2.42469
Std Vapor Volumetric Flow	MMSCFD	0.396684	0.380453	9.72234	9.62833	0.0805066
Std Liquid Volumetric Flow	sgpm	3.03812	2.81093	66.9903	65.4826	2.26717
Compressibility		0.999279	1.00023	0.999664	0.999798	0.00497736
Specific Gravity		1.02329	1.06695	0.936531	0.945676	1.76739
API Gravity						-55.5677
Enthalpy	Btu/h	-240507	-240507	-3.88606E+07	-3.88606E+07	195574
Mass Enthalpy	Btu/lb	-186.316	-186.316	-1342.1	-1342.1	91.2291
Mass Cp	Btu/(lb*°F)	0.245987	0.319454	0.294282	0.299448	0.313248
Ideal Gas CpCv Ratio		1.37598	1.25184	1.33178	1.31996	1.05483
Dynamic Viscosity	cP	0.0196055	0.0671385 ?	0.0263505 ?	0.0282302 ?	381.265
Kinematic Viscosity	cSt	12.0349	222.761 ?	30.7353 ?	36.3797 ?	215.926
Thermal Conductivity	Btu/(h*ft*°F)	0.0159791	0.0701996 ?	0.0248423 ?	0.0273699 ?	0.0851027 ?
Surface Tension	lb/ft					0.00379403

Remarks

Process Streams Report All Streams Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	19	20	21	22	23
From Block	Condenser 2	XCHG-100	Claus Bed 2	Condenser 3	Condenser 3
To Block	XCHG-100	Claus Bed 2	Condenser 3	MIX-104	XCHG-101

Stream Composition

Molar Flow	19 lbmol/h	20 lbmol/h	21 lbmol/h	22 lbmol/h	23 lbmol/h
NH3	5.3829E-05	5.3829E-05	5.3829E-05	4.06319E-11	5.3829E-05
N2	604.052	604.052	604.052	2.74595E-07	604.052
H2S	24.9917	24.9917	9.80853	0.000320474	9.80821
CS2	0.445463	0.445463	0.445463	1.2071E-07	0.445463
COS	0.301875	0.301875	0.301875	2.4248E-09	0.301875
SO2	12.4957	12.4957	4.90411	4.47307E-07	4.90411
H2	19.1083	19.1083	19.1083	1.94018E-08	19.1083
CO	5.38657	5.38657	5.38657	2.33014E-09	5.38657
CO2	35.3661	35.3661	35.3661	6.52413E-07	35.3661
H2O	344.15	344.15	359.333	2.23775E-06	359.333
CH4	0	0	0	0	0
C2H6	0	0	0	0	0
C3H8	0	0	0	0	0
O2	2.56524E-06	2.56524E-06	1.28262E-07	4.97549E-16	1.28262E-07
S1	0	0	0	0	0
S2	0.000336718	0.000336718	0.0180212	0.000725343	6.80785E-05
S3	3.71098E-05	3.71098E-05	0.00193685	7.42872E-05	6.97732E-06
S4	3.54536E-05	3.54536E-05	0.00146869	7.13229E-05	6.7035E-06
S5	0.00430874	0.00430874	0.0605614	0.0119856	0.00112726
S6	0.161521	0.161521	1.10455	0.544153	0.0512121
S7	0.090715	0.090715	0.663119	0.275094	0.0259069
S8	0.731072	0.731072	2.32879	2.79911	0.263777

Stream Properties

Property	Units	19	20	21	22	23
Temperature	°F	360 *	450 *	488.978	320	320 *
Pressure	psia	19.9	19.6	19.1	18.7	18.7
Mole Fraction Vapor	%	100	100	100	0	100
Mole Fraction Light Liquid	%	0	0	0	100	0
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	25.6008	25.6008	25.7088	244.1	24.9506
Mass Density	lb/ft^3	0.0579671	0.0514257	0.0482533	111.048	0.05582
Molar Flow	lbmol/h	1047.29	1047.29	1042.88	3.63154	1039.05
Mass Flow	lb/h	26811.4	26811.4	26811.4	886.459	25924.9
Vapor Volumetric Flow	ft^3/h	462527	521361	555638	7.98266	464437
Liquid Volumetric Flow	gpm	57665.8	65000.9	69274.4	0.99524	57903.9
Std Vapor Volumetric Flow	MMSCFD	9.53829	9.53829	9.4982	0.0330747	9.46326
Std Liquid Volumetric Flow	sgpm	63.2154	63.2154	62.5414	0.937452	61.6039
Compressibility		0.999131	0.999498	0.999585	0.00491274	0.998984
Specific Gravity		0.883926	0.883926	0.887657	1.7805	0.861478
API Gravity					-55.5551	
Enthalpy	Btu/h	-4.1544E+07	-4.08129E+07	-4.08129E+07	68911.9	-4.23953E+07
Mass Enthalpy	Btu/lb	-1549.49	-1522.23	-1522.23	77.7384	-1635.31
Mass Cp	Btu/(lb*°F)	0.301455	0.304408	0.30662	0.385474	0.306169
Ideal Gas CpCv Ratio		1.34735	1.34264	1.33736	1.05488	1.3522
Dynamic Viscosity	cP	0.0228098	0.0248651 ?	0.0256835 ?	11.1248	0.0218964
Kinematic Viscosity	cSt	24.5651	30.1848 ?	33.2281 ?	6.25403	24.4885
Thermal Conductivity	Btu/(h*ft*°F)	0.0215651	0.0237739 ?	0.024866 ?	0.080706 ?	0.0207916
Surface Tension	lb/ft				0.00388098	

Remarks

Process Streams Report **All Streams** Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	24	25	26	27	28
From Block	XCHG-101	Claus Bed 3	Condenser 4	Condenser 4	--
To Block	Claus Bed 3	Condenser 4	MIX-104	MIX-101	CMPR-102

Stream Composition

Molar Flow	24 lbmol/h	25 lbmol/h	26 lbmol/h	27 lbmol/h	28 lbmol/h
NH3	5.3829E-05	5.3829E-05	1.58789E-11	5.3829E-05	0 *
N2	604.052	604.052	5.11995E-08	604.052	221.333 *
H2S	9.80821	4.41888	3.56576E-05	4.41885	0 *
CS2	0.445463	0.445463	3.70732E-08	0.445463	0 *
COS	0.301875	0.301875	6.0332E-10	0.301875	0 *
SO2	4.90411	2.20945	6.5591E-08	2.20945	0 *
H2	19.1083	19.1083	3.81751E-09	19.1083	0 *
CO	5.38657	5.38657	4.40371E-10	5.38657	0 *
CO2	35.3661	35.3661	1.81335E-07	35.3661	0 *
H2O	359.333	364.722	7.59671E-07	364.722	2.8376 *
CH4	0	0	0	0	0 *
C2H6	0	0	0	0	0 *
C3H8	0	0	0	0	0 *
O2	1.28262E-07	6.4131E-09	7.28788E-18	6.4131E-09	59.5896 *
S1	0	0	0	0	0 *
S2	6.80785E-05	0.00201803	0.000146944	1.14271E-05	0 *
S3	6.97732E-06	0.000210827	1.37758E-05	1.072E-06	0 *
S4	6.7035E-06	0.000173646	1.32131E-05	1.02889E-06	0 *
S5	0.00112726	0.0123341	0.00316226	0.000246403	0 *
S6	0.0512121	0.318669	0.176744	0.0137807	0 *
S7	0.0259069	0.176629	0.0790466	0.00616721	0 *
S8	0.263777	0.93415	1.03559	0.0808482	0 *

Stream Properties

Property	Units	24	25	26	27	28
Temperature	°F	400 *	414.435	280	280 *	70 *
Pressure	psia	18.4	17.9	17.5	17.5	14.6959 *
Mole Fraction Vapor	%	100	100	0	100	100
Mole Fraction Light Liquid	%	0	0	100	0	0
Mole Fraction Heavy Liquid	%	0	0	0	0	0
Molecular Weight	lb/lbmol	24.9506	24.9889	245.542	24.7145	28.7504
Mass Density	lb/ft^3	0.0497945	0.0477121	111.854	0.0545505	0.0743637
Molar Flow	lbmol/h	1039.05	1037.46	1.29476	1036.11	283.76 *
Mass Flow	lb/h	25924.9	25924.9	317.918	25607	8158.21
Vapor Volumetric Flow	ft^3/h	520637	543361	2.84226	469418	109707
Liquid Volumetric Flow	gpm	64910.6	67743.8	0.35436	58524.8	13677.7
Std Vapor Volumetric Flow	MMSCFD	9.46326	9.44876	0.0117922	9.43652	2.58438
Std Liquid Volumetric Flow	sgpm	61.6039	61.3647	0.336202	61.0285	18.8006
Compressibility		0.99936	0.999413	0.00483962	0.998824	0.999563
Specific Gravity		0.861478	0.8628	1.79342	0.853324	0.992672
API Gravity				-55.5432		
Enthalpy	Btu/h	-4.17578E+07	-4.17578E+07	21297.3	-4.28986E+07	-309948
Mass Enthalpy	Btu/lb	-1610.72	-1610.72	66.9901	-1675.27	-37.9922
Mass Cp	Btu/(lb*°F)	0.308594	0.309388	0.247555	0.307248	0.243294
Ideal Gas CpCv Ratio		1.34829	1.34632	1.05501	1.3551	1.3977
Dynamic Viscosity	cP	0.0237437	0.0240551 ?	8.2681	0.0209609	0.0181119
Kinematic Viscosity	cSt	29.7677	31.4744 ?	4.61461	23.9878	15.2048
Thermal Conductivity	Btu/(h*ft*°F)	0.0227788	0.0231835 ?	0.077725 ?	0.0198685	0.0146553
Surface Tension	lb/ft			0.00403942		

Remarks

Process Streams Report

All Streams

Tabulated by Total Phase

Client Name:		Job:
Location:		
Flowsheet:	Flowsheet1	

Connections

	29	30	31	32	
From Block	CMPR-102	--	MIX-101	REAC-111	
To Block	MIX-101	MIX-101	REAC-111	--	

Stream Composition

Molar Flow	29 lbmol/h	30 lbmol/h	31 lbmol/h	32 lbmol/h	
NH3	0	0 *	5.3829E-05	1.4187E-09	
N2	221.333	0 *	825.385	825.385	
H2S	0	0 *	4.41885	0	
CS2	0	0 *	0.445463	0	
COS	0	0 *	0.301875	0	
SO2	0	0 *	2.20945	8.595	
H2	0	0 *	19.1083	1.71822E-08	
CO	0	0 *	5.38657	6.20603E-09	
CO2	0	0 *	35.3661	59.548	
H2O	2.8376	0 *	367.56	426.003	
CH4	0	16.024 *	16.024	0	
C2H6	0	0.50602 *	0.50602	0	
C3H8	0	0.337347 *	0.337347	0	
O2	59.5896	0 *	59.5896	2.64504	
S1	0	0 *	0	0	
S2	0	0 *	1.14271E-05	0	
S3	0	0 *	1.072E-06	0	
S4	0	0 *	1.02889E-06	0	
S5	0	0 *	0.000246403	0	
S6	0	0 *	0.0137807	0	
S7	0	0 *	0.00616721	0	
S8	0	0 *	0.0808482	0	

Stream Properties

Property	Units	29	30	31	32	
Temperature	°F	111.469	70 *	243.295	1199.98	
Pressure	psia	17.5 *	17.5 *	17.5	17.4	
Mole Fraction Vapor	%	100	100	99.995	100	
Mole Fraction Light Liquid	%	0	0	0.00504506	0	
Mole Fraction Heavy Liquid	%	0	0	0	0	
Molecular Weight	lb/lbmol	28.7504	17.0243	25.4742	25.7548	
Mass Density	lb/ft^3	0.0821065	0.0525723	0.0591515	0.0251557	
Molar Flow	lbmol/h	283.76	16.8673 *	1336.74	1322.18	
Mass Flow	lb/h	8158.21	287.155	34052.3	34052.3	
Vapor Volumetric Flow	ft^3/h	99361.3	5462.09	575680	1.35366E+06	
Liquid Volumetric Flow	gpm	12387.9	680.988	71773.1	168769	
Std Vapor Volumetric Flow	MMSCFD	2.58438	0.153621	12.1745	12.0419	
Std Liquid Volumetric Flow	sgpm	18.8006	1.85776	81.6868	79.977	
Compressibility		0.999765	0.996968	0.999021	1.00021	
Specific Gravity		0.992672	0.587804		0.889243	
API Gravity						
Enthalpy	Btu/h	-227764	-548605	-4.3675E+07	-4.3675E+07	
Mass Enthalpy	Btu/lb	-27.9184	-1910.49	-1282.58	-1282.58	
Mass Cp	Btu/(lb*°F)	0.243668	0.517557	0.294056 ?	0.332962	
Ideal Gas CpCv Ratio		1.39687	1.29234	1.3618	1.30147	
Dynamic Viscosity	cP	0.019197	0.0109273		0.0402295	
Kinematic Viscosity	cSt	14.596	12.9758		99.8362	
Thermal Conductivity	Btu/(h*ft*°F)	0.0156217	0.0189572		0.0400306 ?	
Surface Tension	lbf/ft					

Remarks

* User Specified Values

? Extrapolated or Approximate Values

ProMax 3.2.11188.0

Copyright © 2002-2011 BRE Group, Ltd.

Licensed by Bryan Research & Engineering, Inc.

Energy Stream Report

Client Name:		Job:	
Location:			
Flowsheet:	Flowsheet1		

Energy Streams

Energy Stream	Energy Rate		Power		From Block	To Block
Q-1	529106	Btu/h	207.946	hp	--	CMPR-100
Q-2	27618.8	Btu/h	10.8546	hp	--	CMPR-101
Q-3	1.29812E+07	Btu/h	5101.79	hp	REAC-102	--
Q-4	7.58537E+06	Btu/h	2981.16	hp	REAC-103	--
Q-5	2.64952E+06	Btu/h	1041.3	hp	Condenser 1	--
Q-6	2.48773E+06	Btu/h	977.716	hp	Condenser 2	--
Q-7	731012	Btu/h	287.299	hp	--	XCHG-100
Q-8	637566	Btu/h	250.573	hp	--	XCHG-101
Q-9	1.51347E+06	Btu/h	594.815	hp	Condenser 3	--
Q-10	1.11955E+06	Btu/h	440	hp	Condenser 4	--
Q-11	82183.8	Btu/h	32.2995	hp	--	CMPR-102

Remarks

Recoveries Report

Client Name:

Job:

Location:

Component Recoveries - Sulfur Recovery [User Defined]

Status: Solved

Reference Stream Data Source - User Selection

Flowsheet	PStream	Flowsheet	PStream
Flowsheet1	Acid Gas	Flowsheet1	SWS Gas

Recovery Stream Data Source - User Selection

Flowsheet	PStream	Flowsheet	PStream
Flowsheet1	10	Flowsheet1	22
Flowsheet1	18	Flowsheet1	26

Parameters

Composition Basis	Molar Flow	* Atomic Basis	True
Calculate Ratios	True	Summation Only	False

Tabulated Data

Index	Flowsheet1:10 %	Flowsheet1:18 %	Flowsheet1:22 %	Flowsheet1:26 %
Hydrogen, Monatomic	0.0031913	0.000681749	8.47417E-05	9.56333E-06
Nitrogen, Monatomic	1.27042E-05	4.79823E-06	1.09846E-06	2.0483E-07
S1	48.6309	30.3894	12.5662	4.50672
Carbon, Graphite	1.21517E-05	5.71947E-06	1.87441E-06	5.288E-07
Oxygen, Monatomic	3.06964E-05	1.23767E-05	3.51584E-06	9.93E-07

Index	Summary Table %			
Hydrogen, Monatomic	0.00396735			
Nitrogen, Monatomic	1.88058E-05			
S1	96.0932			
Carbon, Graphite	2.02744E-05			
Oxygen, Monatomic	4.7582E-05			

Remarks

Component Recoveries - Flowsheet2 Inlets

Status: Solved

Recovery Stream Data Source - All Inlets in Flowsheet

Flowsheet	PStream	Flowsheet	PStream
Flowsheet2	1		

Parameters

* Composition Basis	Molar Flow	* Atomic Basis	False
* Calculate Ratios	False	* Summation Only	False

Tabulated Data

Index	Flowsheet2:1 lbmol/h	Summary Table lbmol/h		
NH3	0	0		
N2	28.0225	28.0225		
H2S	6.30016	6.30016		
CS2	0	0		
COS	0	0		
SO2	0	0		
H2	0	0		

Energy Budgets Report

Client Name:

Job:

Location:

Heat Budget - Project Power Budget

Status: Solved

Power Budget Data Source - All in Project

Flowsheet	Block	Flowsheet	Block
Flowsheet1	CMPR-100	Flowsheet1	CMPR-102
Flowsheet1	CMPR-101		

Parameters

Net Power	251.1 hp	Total Power Required	251.1 hp
Total Power Supplied	0 hp		

Tabulated Data

Index	Block Power hp	Compression Ratio	Delta P psi	Head ft
Flowsheet1:CMPR-100	207.946	1.54464	8.00405	13173.2
Flowsheet1:CMPR-101	10.8546	1.56506	8.30405	13596.9
Flowsheet1:CMPR-102	32.2995	1.1908	2.80405	5095.41

Remarks

Heat Budget - Project Heat Budget

Status: Solved

Heat Budget Data Source - All in Project

Flowsheet	Block	Flowsheet	Block
Flowsheet1	Condenser 1	Flowsheet1	REAC-103
Flowsheet1	Condenser 2	Flowsheet1	XCHG-100
Flowsheet1	Condenser 3	Flowsheet1	XCHG-101
Flowsheet1	Condenser 4	Flowsheet2	REAC-100
Flowsheet1	REAC-102		

Parameters

Net Duty	-2.81081E+07 Btu/h	Total Duty Required	1.36858E+06 Btu/h
Total Duty Supplied	2.94767E+07 Btu/h		

Tabulated Data

Index	Block Duty Btu/h	Block Highest Temperature °F	Block Lowest Temperature °F	
Flowsheet1:Condenser 1	-2.64952E+06	640	400	
Flowsheet1:Condenser 2	-2.48773E+06	610.04	360	
Flowsheet1:Condenser 3	-1.51347E+06	488.978	320	
Flowsheet1:Condenser 4	-1.11955E+06	414.435	280	
Flowsheet1:REAC-102	-1.29812E+07	2350.87	1200	
Flowsheet1:REAC-103	-7.58537E+06	1200	640	
Flowsheet1:XCHG-100	731012	450	360	
Flowsheet1:XCHG-101	637566	400	320	
Flowsheet2:REAC-100	-1.13986E+06	165.359	165.359	

Remarks

Heat Budget - Flowsheet1 Power Budget

Status: Solved

Energy Budgets Report

Client Name:

Job:

Location:

Power Budget Data Source - All in Flowsheet

Flowsheet	Block	Flowsheet	Block
Flowsheet1	CMPR-100	Flowsheet1	CMPR-102
Flowsheet1	CMPR-101		

Parameters

Net Power	251.1 hp	Total Power Required	251.1 hp
Total Power Supplied	0 hp		

Tabulated Data

Index	Block Power hp	Compression Ratio	Delta P psi	Head ft
Flowsheet1:CMPR-100	207.946	1.54464	8.00405	13173.2
Flowsheet1:CMPR-101	10.8546	1.56506	8.30405	13596.9
Flowsheet1:CMPR-102	32.2995	1.1908	2.80405	5095.41

Remarks

Heat Budget - Flowsheet1 Heat Budget

Status: Solved

Heat Budget Data Source - All in Flowsheet

Flowsheet	Block	Flowsheet	Block
Flowsheet1	Condenser 1	Flowsheet1	REAC-102
Flowsheet1	Condenser 2	Flowsheet1	REAC-103
Flowsheet1	Condenser 3	Flowsheet1	XCHG-100
Flowsheet1	Condenser 4	Flowsheet1	XCHG-101

Parameters

Net Duty	-2.69682E+07 Btu/h	Total Duty Required	1.36858E+06 Btu/h
Total Duty Supplied	2.83368E+07 Btu/h		

Tabulated Data

Index	Block Duty Btu/h	Block Highest Temperature °F	Block Lowest Temperature °F
Flowsheet1:Condenser 1	-2.64952E+06	640	400
Flowsheet1:Condenser 2	-2.48773E+06	610.04	360
Flowsheet1:Condenser 3	-1.51347E+06	488.978	320
Flowsheet1:Condenser 4	-1.11955E+06	414.435	280
Flowsheet1:REAC-102	-1.29812E+07	2350.87	1200
Flowsheet1:REAC-103	-7.58537E+06	1200	640
Flowsheet1:XCHG-100	731012	450	360
Flowsheet1:XCHG-101	637566	400	320

Remarks

Heat Budget - Flowsheet2 Power Budget

Status: Solved

Parameters

Net Power	0 hp	Total Power Required	0 hp
Total Power Supplied	0 hp		

Remarks

Energy Budgets Report

Client Name:

Location:

Job:

Heat Budget - Flowsheet2 Heat Budget

Status: Solved

Heat Budget Data Source - All in Flowsheet

Flowsheet	Block	Flowsheet	Block
Flowsheet2	REAC-100		

Parameters

Net Duty	-1.13986E+06 Btu/h	Total Duty Required	0 Btu/h
Total Duty Supplied	1.13986E+06 Btu/h		

Tabulated Data

Index	Block Duty Btu/h	Block Highest Temperature °F	Block Lowest Temperature °F	
Flowsheet2:REAC-100	-1.13986E+06	165.359	165.359	

Remarks

END OF ABBREVIATED ProMax[®] OUTPUT


CLAUS SULFUR PLANT

G6 DEMONSTRATION
GAS TREATING & SULFUR RECOVERY. DJM

PROGRAM: _____

CASE: _____

	CONV. 1	CONV. 2	CONV. 3
converter outlet temp	°	°	°
converter outlet sulfur dewpoint	°	°	°
sulfur dewpoint margin ±	°	°	°

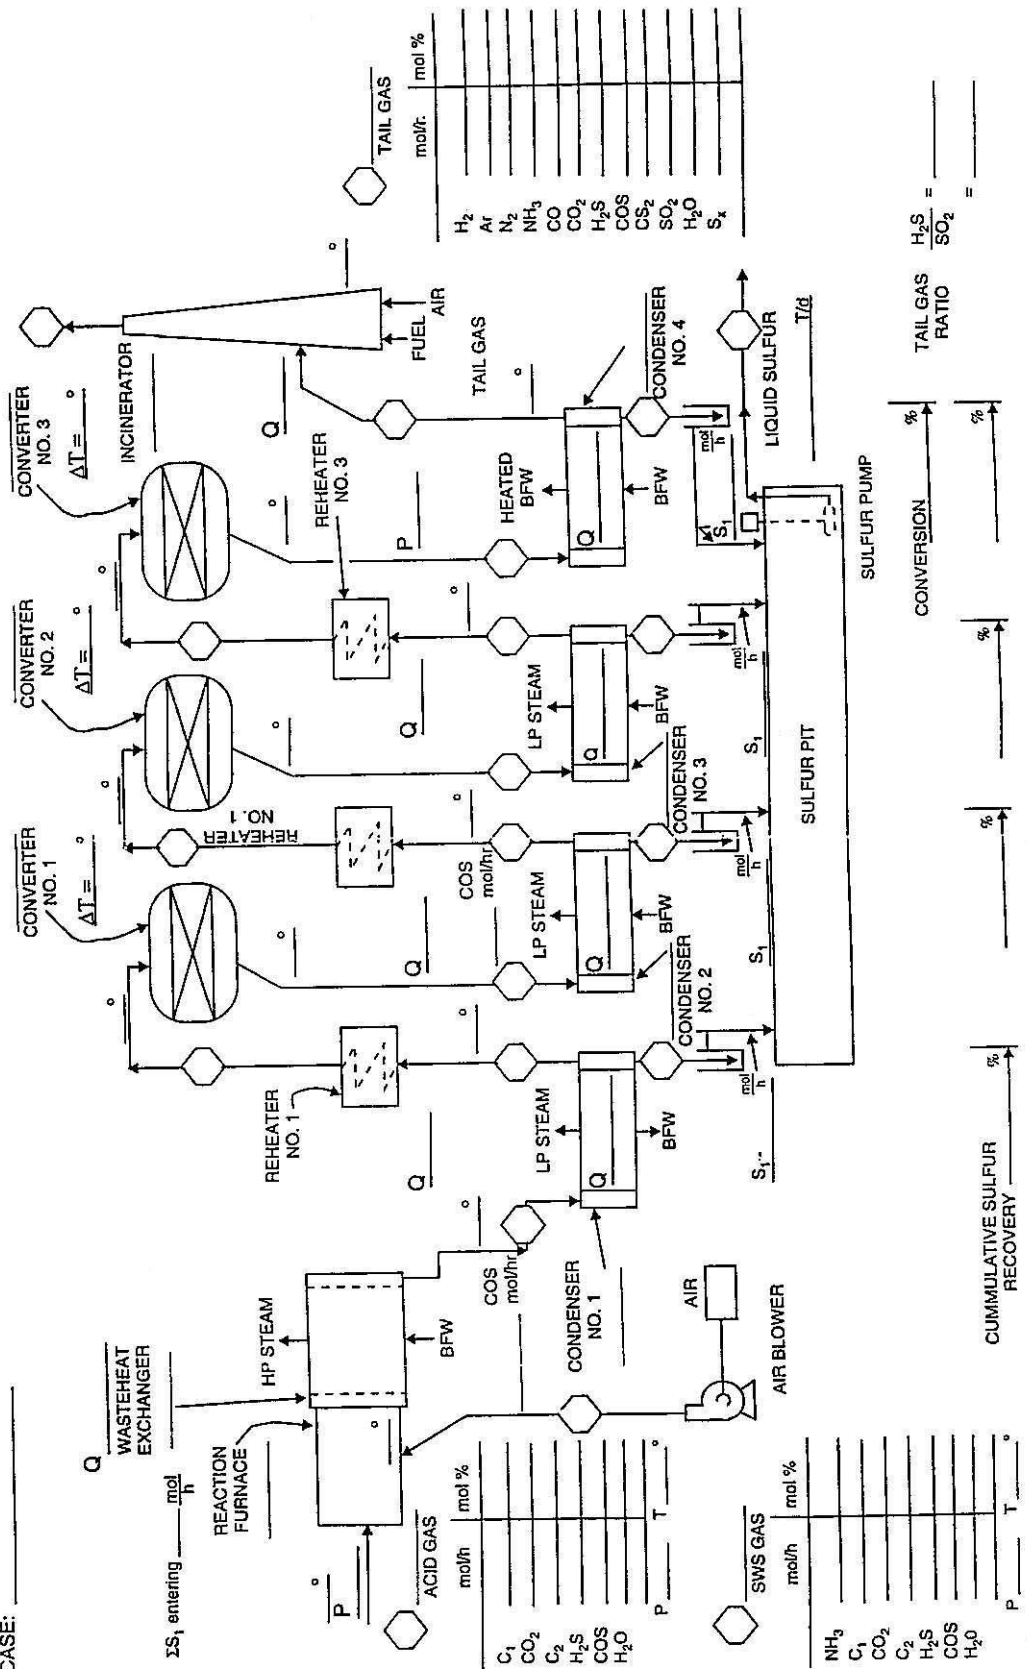


CLAUS SULFUR PLANT

G6 DEMONSTRATION
GAS TREATING & SULFUR RECOVERY. DJM
PROGRAM: Pro Max 3.2

CASE: BRIMSTONE

converter outlet temp
converter outlet sulfur dewpoint
sulfur dewpoint margin ±

CONV. 1	CONV. 2	CONV. 3
610°	489°	414°
470°	420°	371°
140°	69°	43°

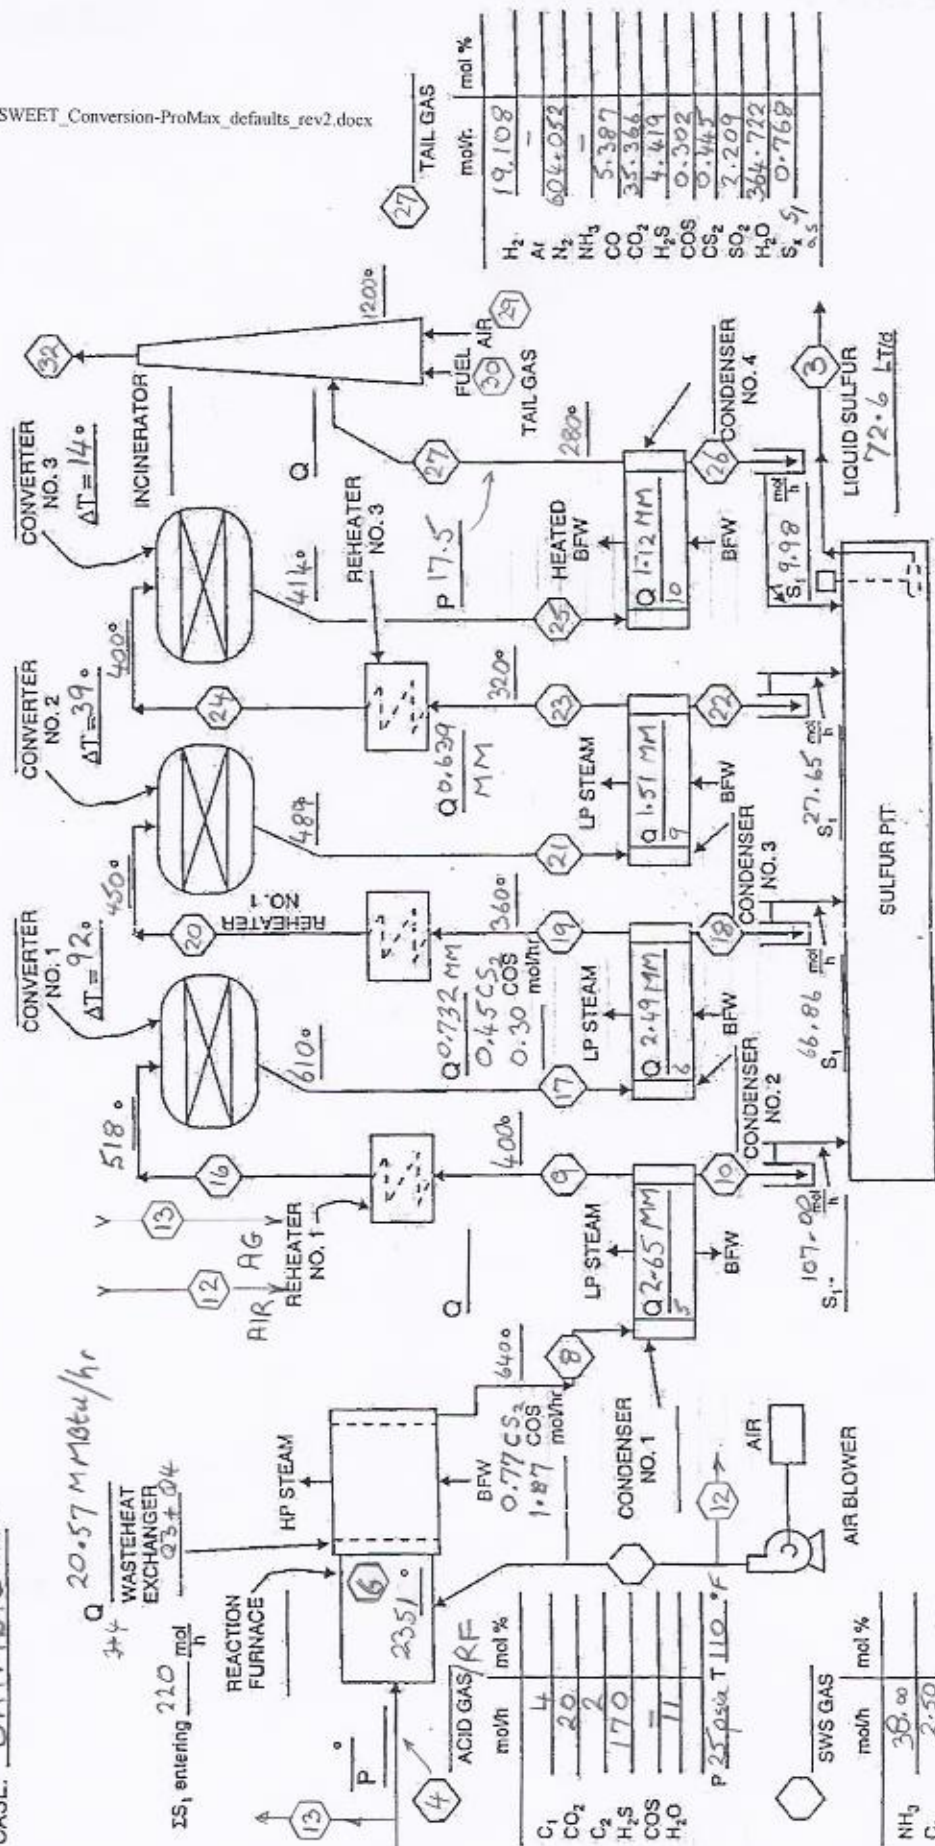

	mol/h	mol %
H ₂	19.108	
Ar	604.052	
N ₂		
NH ₃	5.387	
CO	35.366	
CO ₂	4.419	
H ₂ S	0.302	
COS	0.443	
SO ₂	2.209	
H ₂ O	364.712	
S ₂	0.768	

$$\frac{H_2S}{SO_2} = \frac{4.42}{2.21} = 2.01:1$$

TAIL GAS RATIO

CONVERSION %

96.09 %

79.02 %

CUMULATIVE SULFUR RECOVERY %

48.63 %

SWS GAS	mol/h	mol %
NH ₃	38.00	
C ₁	2.50	
CO ₂	5.00	
C ₂ /C ₃	45.10	
H ₂ S	50.00	
COS	65.36	
H ₂ O	2.00	
N ₂		
P23	195.1	

Brimstone 2009_4-15

BLANK PAGE